



REVERSIBLE AIR-TO-WATER HEAT PUMP



AquaSnap® 30AWH-P 004÷014



The 30AWH-P air-to-water heat pump is designed for heating and cooling applications in new and existing individual homes and small businesses. When installed alone, the 30AWH-P is compatible with low to medium temperature emitters (underfloor heating, fan coil units, water cassettes, radiators, mixed installations, etc.).

The 30AWH-P is also compatible with medium to high temperature emitters for boiler back up operation back up operation.

The 30AWH-P heat pump is installed outside in an open area, ideally as close as possible to the boiler room.

Each device is tested in the factory and delivered ready for operation.

INDEX

PRODUCT DESCRIPTION	3
TECHNICAL DATA	4
TECHNICAL DATA ERP	8
PERFORMANCE VALUES IN ACCORDANCE WITH STANDARDS EN 14511 AND EN 14825	10
PERFORMANCE DATA - HEATING CAPACITIES IN ACCORDANCE WITH EN14511	18
PERFORMANCE DATA - COOLING CAPACITIES IN ACCORDANCE WITH EN14511	22
OPERATING RANGE	24
DIMENSIONS AND LOCATION OF HYDRAULIC CONNECTIONS	25
PLACE OF INSTALLATION	25
HYDRAULIC MODULE	27
HYDRAULIC CONNECTIONS	28
ELECTRICAL CONNECTIONS	31
CONTROL PANEL	35
MAIN ACCESSORIES	36
SPECIFICATION DESCRIPTIONS	41

PRODUCT DESCRIPTION

30AWH-P is a high energy efficient residential hydronic heat pump for heating, cooling and possible production of domestic hot water for domestic use.

The unit is suitable for low to medium temperature applications, and up to high temperature applications.

The unit operates on natural refrigerant R290 ensuring not only low Global Warming Potential (GWP=3) and CO₂ emission, but also powerful performance with high energy efficiency at all times.

30AWH-P is also equipped with new Blue-Fin exchange coils, a special hydrophilic and anti-corrosion treatment, which improves the flow of condensation on the fins thus reducing the risk of freezing on the coil.

30AWH-P is available in 8 different models with heating capacity from 4.0 to 13.8 kW.

- High water heating temperature up to +75°C, ensure more usable hot water and helps to avoid the need for direct electric immersion to sterilize the water protecting from legionella
- HP Keymark certified performance
- High COP and EER
- Very silent operation
- DC-Inverter technology with Twin-Rotary compressor which modulates the power necessary to perfectly match the real needed load
- They can be connected to low-temperature radiators, underfloor radiant elements and fan coil type units
- Easy and quick installation
- Controller WUI is included which is able to manage completely heating/ cooling/ domestic hot water system
- The controller WUI can manage up to 4 units in cascade system (1 master & 3 slaves)
- Anti-freeze program protects the entire system especially the hydraulic parts from damage in very cold ambient air temperature

TECHNICAL DATA

30AWH-P 004÷014

Model		30AWH-P					
		004	006	008	010	012	014
PERFORMANCE DATA IN HEATING							
Performance in heating (A7°C; W35°C)							
Nominal capacity	kW	3,95	5,80	7,60	9,60	11,40	13,80
Power consumption	kW	0,81	1,18	1,58	2,21	2,51	3,21
COP		4,90	4,90	4,80	4,35	4,55	4,30
SCOP (temperate zone)		4,70	4,82	4,69	4,69	4,74	4,74
Seasonal energy efficiency	%	185	190	185	185	187	187
Energy class		A+++	A+++	A+++	A+++	A+++	A+++
Performance in heating (A7°C; W45°C)							
Nominal capacity	kW	3,85	5,50	7,80	9,50	10,80	13,60
Power consumption	kW	1,05	1,51	2,08	2,68	2,96	4,00
COP		3,65	3,65	3,75	3,55	3,65	3,40
Performance in heating (A7°C; W55°C)							
Nominal capacity	kW	3,75	5,25	7,55	9,40	10,95	13,25
Power consumption	kW	1,27	1,78	2,40	3,19	3,53	4,57
COP		2,95	2,95	3,15	2,95	3,10	2,90
SCOP (Temperate zone)		3,34	3,34	3,34	3,34	3,35	3,35
Seasonal energy efficiency	%	131	131	131	131	131	131
Energy class		A++	A++	A++	A++	A++	A++
PERFORMANCE DATA IN COOLING							
Performance in cooling (A35°C; W7°C)							
Nominal capacity	kW	3,35	4,60	6,50	7,40	9,70	10,70
Power consumption	kW	1,06	1,46	2,13	2,55	3,18	3,63
EER		3,15	3,15	3,05	2,90	3,05	2,95
SEER		4,93	5,34	5,27	5,14	5,33	5,16
Seasonal energy efficiency	%	194	211	208	203	210	203
Performance in cooling (A35°C; W18°C)							
Nominal capacity	kW	4,00	6,15	8,00	8,90	12,00	14,50
Power consumption	kW	0,96	1,58	2,00	2,41	2,79	3,92
EER		4,15	3,90	4,00	3,70	4,30	3,70
ELECTRICAL CHARACTERISTICS							
Power supply	V/ph/Hz	230/1/50	230/1/50	230/1/50	230/1/50	230/1/50	230/1/50
Total maximum input power	(1) kW	3,50	4,40	5,00	6,40	7,10	7,10
Total maximum input current	(2) A	15,10	19,20	21,60	27,90	30,80	30,80
COMPRESSOR							
Compressor	Type	Rotary					
Adjustment	Type	Inverter modulating					
Minimum capacity control	%	40%	32%	34%	27%	25%	21%
Refrigerant	Type	R290	R290	R290	R290	R290	R290
GWP	CO2 equiv. In t/kg	3	3	3	3	3	3
Refrigerant load	kg	0,39	0,58	0,76	0,76	1,07	1,07
Control box load	CO2 equiv. In t	0,001	0,002	0,002	0,002	0,003	0,003
Number of circuits	n.	1	1	1	1	1	1
Hermetically sealed control box	yes/no	yes	yes	yes	yes	yes	yes
FAN							
Fan	Type	Axial					
Quantity	n.	1	1	1	1	2	2
Maximum air flow rate	m³/h	2880	2880	2880	2880	6480	6480
Residual head	KPa	-	-	-	-	-	-

Model		30AWH-P					
		004	006	008	010	012	014
HEAT EXCHANGER SOURCE SIDE							
Heat exchanger source side	Type	Pipes in copper. fins in hydrophilic aluminium					
CIRCULATION PUMP							
Circulation pump	Type/set	Variable speed centrifuge					
Nominal delivery	m ³ /h	0,68	1,00	1,31	1,66	1,97	2,38
Useful head at nominal flow rate	Kpa	83	82	70	57	100	82
Maximum input power	W	75	75	75	75	140	140
Minimum input power	W	2	2	2	2	3	3
Safety valve calibration pressure	bar	3	3	3	3	3	3
Expansion tank volume	(3) l	-	-	-	-	-	-
HEAT EXCHANGER (SYSTEM SIDE)							
Heat exchanger system side	Type	Plate					
Water capacity	l	0,6	0,9	0,9	0,9	1,5	1,5
SOUND DATA							
Sound output A7/W55	(4) dB(A)	49	50	51	51	54	54
Sound pressure aT 5m / 1m conditions A7/W55	(5) dB(A)	23,5/37,5	24,5/38,5	25,5/39,5	25,5/39,5	28/42	28/42
WEIGHT							
Net weight	kg	78	84	91	93	126	126

Performance is in accordance with EN 14511 and EN 14825.

- (1) Power input, compressors, and fans, at unit operating limits and nominal voltage (data on unit nameplate)
(2) Maximum operating current of the unit at maximum power consumption of the unit at nominal voltage (values on unit nameplate)
(3) Component not supplied with the product
(4) In dB ref=10-12 W, weighting (A). Sound emission values declared, in accordance with standard EN 12102-1 (with an associated uncertainty of +/-2dB(A)). Measurement according to ISO 9614-1.
(5) In dB ref 20 Pa, weighting (A). Sound emission values declared, in accordance with standard EN 12102-1 (with an associated uncertainty of +/-2dB(A)). Values provided for information, calculated from the sound power level Lw(A)

30AWH-P 012T÷014T

Model		30AWH-P	
		012T	014T
PERFORMANCE DATA IN HEATING			
Performance in heating (A7°C; W35°C)			
Nominal capacity	kW	11,40	13,80
Power consumption	kW	2,45	3,14
COP		4,65	4,40
SCOP (Temperate zone)		4,74	4,74
Seasonal energy efficiency	%	187	187
Energy class		A+++	A+++
Performance in heating (A7°C; W45°C)			
Nominal capacity	kW	10,80	13,60
Power consumption	kW	2,88	3,89
COP		3,75	3,50
Performance in heating (A7°C; W55°C)			
Nominal capacity	kW	10,95	13,25
Power consumption	kW	3,48	4,49
COP		3,15	2,95
SCOP (Temperate zone)		3,35	3,35
Seasonal energy efficiency	%	131	131
Energy class		A++	A++
PERFORMANCE DATA IN COOLING			
Performance in cooling (A35°C; W7°C)			
Nominal capacity	kW	9,70	10,70
Power consumption	kW	3,13	3,57
EER		3,10	3,00
SEER		5,33	5,16
Seasonal energy efficiency	%	210	203
Performance in cooling (A35°C; W18°C)			
Nominal capacity	kW	12,00	14,50
Power consumption	kW	2,76	3,87
EER		4,35	3,75
ELECTRICAL CHARACTERISTICS			
Power supply	V/ph/Hz	400/3/50	400/3/50
Total maximum input power	(1) kW	10,50	10,50
Total maximum input current	(2) A	16,10	16,10
COMPRESSOR			
Compressor	Type	Rotary	
Adjustment	Type	Inverter modulating	
Minimum capacity control	%	25%	21%
Refrigerant	Type	R290	R290
GWP	CO2 equiv. In t/kg	3	3
Refrigerant load	kg	1,07	1,07
Control box load	CO2 equiv. In t	0,003	0,003
Number of circuits	n.	1	1
Hermetically sealed control box	yes/no	yes	yes
FAN			
Fan	Type	Axial	
Quantity	n.	2	2
Maximum air flow rate	m³/h	6480	6480
Residual head	kPa	-	-

Model		30AWH-P	
		012T	014T
HEAT EXCHANGER SOURCE SIDE			
HEAT EXCHANGER SOURCE SIDE	Type	Pipes in copper. fins in hydrophilic aluminium	
CIRCULATION PUMP			
Circulation pump	Type/set	Variable speed centrifuge	
Nominal delivery	m ³ /h	1,97	2,38
Useful head at nominal flow rate	kPa	100	82
Maximum input power	W	140	140
Minimum input power	W	3	3
Safety valve calibration pressure	bar	3	3
Expansion tank volume	(3) l	-	-
HEAT EXCHANGER (SYSTEM SIDE)			
Heat exchanger system side	Type	Plate	
Water capacity	l	1,5	1,5
SOUND DATA			
Sound output A7/W55	(4) dB(A)	54	54
Sound pressure aT 5m / 1m conditions A7/W55	(5) dB(A)	28/42	28/42
WEIGHT			
Net weight	kg	128	128

Performance is in accordance with EN 14511 and EN 14825.

- (1) Power input, compressors, and fans, at unit operating limits and nominal voltage (data on unit nameplate)
(2) Maximum operating current of the unit at maximum power consumption of the unit at nominal voltage (values on unit nameplate)
(3) Component not supplied with the product
(4) In dB ref=10-12 W, weighting (A). Sound emission values declared, in accordance with standard EN 12102-1 (with an associated uncertainty of +/-2dB(A)). Measurement according to ISO 9614-1 and Eurovent certification.
(5) In dB ref 20 Pa, weighting (A). Sound emission values declared, in accordance with standard EN 12102-1 (with an associated uncertainty of +/-2dB(A)). Values provided for information, calculated from the sound power level Lw(A)

TECHNICAL DATA ERP

30AWH-P 004-014

DESCRIPTION	UM	30AWH-P					
		004	006	008	010	012	014
Temperate zone - Low temperature (30/35°C) EU reg. 811_2013							
Seasonal energy efficiency	%	185	190	185	185	187	187
SCOP		4,70	4,82	4,69	4,69	4,74	4,74
Pdeclaredh a -7°C	kW	3,36	4,32	5,69	5,69	8,27	8,27
Annual energy consumption	kWh/year	1666	2092	2829	2829	4068	4068
Energy class		A+++	A+++	A+++	A+++	A+++	A+++
Sound output	dB(A)	49	50	51	51	54	54
Temperate zone - Medium temperature (47/55°C) Reg. UE 811_2013							
Seasonal energy efficiency	%	131	131	131	131	131	131
SCOP		3,34	3,34	3,34	3,34	3,35	3,35
Pdeclaredh a -7°C	kW	3,06	4,31	5,71	5,71	8,25	8,25
Annual energy consumption	kWh/year	2138	3010	3989	3989	5743	5743
Energy class		A++	A++	A++	A++	A++	A++
Warm zone - Low temperature (30/35°C)							
Seasonal energy efficiency	%	259	258	252	252	253	253
SCOP		6,48	6,45	6,30	6,30	6,33	6,33
Pdeclaredh a +2°C	kW	4,07	5,14	7,62	7,62	11,14	11,14
Annual energy consumption	kWh/year	827	1048	1595	1595	2327	2327
Warm zone - Low temperature(47/55°C)							
Seasonal energy efficiency	%	168	170	174	174	173	173
SCOP		4,20	4,25	4,35	4,35	4,33	4,33
Pdeclaredh a +2°C	kW	4,37	5,14	7,62	7,62	11,14	11,14
Annual energy consumption	kWh/year	1359	1589	2294	2294	3386	3386
Cold zone - Low temperature (30/35°C)							
Seasonal energy efficiency	%	154	153	151	151	154	154
SCOP		3,85	3,83	3,78	3,78	3,85	3,85
Pdeclaredh a -7°C	kW	3,36	4,32	5,69	5,69	8,27	8,27
Annual energy consumption	kWh/year	3326	4299	5759	5759	8193	8193
Cold zone - Low temperature (47/55°C)							
Seasonal energy efficiency	%	114	116	114	114	119	119
SCOP		2,85	2,90	2,85	2,85	2,98	2,98
Pdeclaredh a -7°C	kW	3,06	4,31	5,71	5,71	8,25	8,25
Annual energy consumption	kWh/anno	4061	5655	7619	7619	10498	10498

The performance values comply with Standards: EN 14511 - EN 14825

30AWH-P 012T÷014T

DESCRIPTION		30AWH-P	
		012T	014T
Temperate zone - Low temperature (30/35°C) EU reg. 811_2013			
Seasonal energy efficiency	%	187	187
SCOP		4,74	4,74
Pdeclaredh a -7°C	kW	8,27	8,27
Annual energy consumption	kWh/year	4068	4068
Energy class		A+++	A+++
Sound output	dB(A)	54	54
Temperate zone - Medium temperature (47/55°C) Reg. UE 811_2013			
Seasonal energy efficiency	%	131	131
SCOP		3,35	3,35
Pdeclaredh a -7°C	kW	8,25	8,25
Annual energy consumption	kWh/year	5743	5743
Energy class		A++	A++
Warm zone - Low temperature (30/35°C)			
Seasonal energy efficiency	%	253	253
SCOP		6,33	6,33
Pdeclaredh a +2°C	kW	11,14	11,14
Annual energy consumption	kWh/year	2327	2327
Warm zone - Low temperature(47/55°C)			
Seasonal energy efficiency	%	173	173
SCOP		4,33	4,33
Pdeclaredh a +2°C	kW	11,14	11,14
Annual energy consumption	kWh/year	3386	3386
Cold zone - Low temperature (30/35°C)			
Seasonal energy efficiency	%	154	154
SCOP		3,85	3,85
Pdeclaredh a -7°C	kW	8,27	8,27
Annual energy consumption	kWh/year	8186	8186
Cold zone - Low temperature (47/55°C)			
Seasonal energy efficiency	%	119	119
SCOP		2,98	2,98
Pdeclaredh a -7°C	kW	8,25	8,25
Annual energy consumption	kWh/year	10498	10498

The performance values comply with Standards: EN 14511 - EN 14825

PERFORMANCE VALUES IN ACCORDANCE WITH STANDARDS EN 14511 AND EN 14825

30AWH-P 004

HEATING

Performance with full load

CH flow temperature	35°C		45°C		55°C	
	Nominal capacity	COP	Nominal capacity	COP	Nominal capacity	COP
Outdoor temperature						
-7	3,35	2,75	3,11	2,17	3,05	1,85
2	3,75	3,70	3,49	2,91	3,55	2,40
7	3,95	4,90	3,85	3,65	3,75	2,95
12	4,09	5,47	3,98	4,09	3,78	3,14
15	4,16	6,06	3,98	4,42	3,83	3,34
20	4,27	7,06	3,98	4,98	3,90	3,68
35					4,32	4,11

Performance with partial load

Tbival (-7°C)	A	B	C	D
Outdoor temperature	-7	2	7	12
PLR - Climate load factor	0,88	0,54	0,35	0,15
DC - Output with full load	3,35	3,75	3,95	4,09
COP with full load	2,75	3,70	4,90	5,47
COP with partial load	2,75	3,70	4,10	3,38
CR - Load factor	1,00	0,55	0,34	0,14
f COP - Corrective factor	1,00	1,00	0,84	0,62

COOLING

	Climate load factor	Outdoor temperature	EER	Nominal capacity
EER1	100%	35	3,15	3,35
EER2	75%	30	4,30	2,47
EER3	50%	25	6,09	1,59
EER4	25%	20	7,98	1,71

Heating

The performance values comply with Standards EN 14511 and EN 14825.
The performance values with a part load refer to a water delivery temperature of 35°C.

Cooling

The performance values comply with Standards EN 14825.

30AWH-P 006

HEATING						
Performance with full load						
CH flow temperature	35°C		45°C		55°C	
Outdoor temperature	Nominal capacity	COP	Nominal capacity	COP	Nominal capacity	COP
-7	4,15	2,71	4,02	2,49	4,00	1,90
2	4,65	3,70	4,58	3,14	4,45	2,45
7	5,80	4,90	5,50	3,65	5,25	2,95
12	5,99	5,49	5,66	4,09	5,55	3,22
15	6,12	6,10	5,83	4,49	5,78	3,46
20	6,35	7,12	6,10	5,16	6,16	3,86
35					6,46	4,45
Performance with partial load						
Tbival (-7°C)	A	B	C	D		
Outdoor temperature	-7	2	7	12		
PLR - Climate load factor	0,88	0,54	0,35	0,15		
DC - Output with full load	4,15	4,65	5,80	5,99		
COP with full load	2,70	3,70	4,90	5,49		
COP with partial load	2,70	3,70	3,92	3,14		
CR - Load factor	1,00	0,55	0,28	0,12		
f COP - Corrective factor	1,00	1,00	0,80	0,57		

COOLING				
	Climate load factor	Outdoor temperature	EER	Nominal capacity
EER1	100%	35	3,15	4,60
EER2	75%	30	4,60	3,39
EER3	50%	25	6,43	2,18
EER4	25%	20	8,17	2,05

Heating

The performance values comply with Standards EN 14511 and EN 14825.
The performance values with a part load refer to a water delivery temperature of 35°C.

Cooling

The performance values comply with Standards EN 14825.

30AWH-P 008

HEATING						
Performance with full load						
CH flow temperature	35°C		45°C		55°C	
Outdoor temperature	Nominal capacity	COP	Nominal capacity	COP	Nominal capacity	COP
-7	5,85	2,71	5,58	2,53	5,45	1,93
2	7,00	3,50	7,13	3,05	7,00	2,45
7	7,60	4,80	7,80	3,75	7,55	3,15
12	8,02	5,64	8,02	4,28	7,95	3,43
15	8,23	6,30	8,17	4,74	8,09	3,73
20	8,57	7,39	8,41	5,50	8,34	4,24
35					8,84	4,43
Performance with partial load						
Tbival (-7°C)	A	B	C	D		
Outdoor temperature	-7	2	7	12		
PLR - Climate load factor	0,88	0,54	0,35	0,15		
DC - Output with full load	5,85	7,00	7,60	8,02		
COP with full load	2,70	3,50	4,80	5,64		
COP with partial load	2,70	3,50	3,91	3,31		
CR - Load factor	1,00	0,51	0,31	0,12		
f COP - Corrective factor	1,00	1,00	0,82	0,59		

COOLING				
	Climate load factor	Outdoor temperature	EER	Nominal capacity
EER1	100%	35	3,05	6,50
EER2	75%	30	4,49	4,79
EER3	50%	25	6,36	3,08
EER4	25%	20	7,33	2,95

Heating

The performance values comply with Standards EN 14511 and EN 14825.
 The performance values with a part load refer to a water delivery temperature of 35°C.

Cooling

The performance values comply with Standards EN 14825.

30AWH-P 010

HEATING						
Performance with full load						
CH flow temperature	35°C		45°C		55°C	
Outdoor temperature	Nominal capacity	COP	Nominal capacity	COP	Nominal capacity	COP
-7	5,85	2,71	5,58	2,53	5,45	1,93
2	7,80	3,05	7,71	2,75	7,80	2,15
7	9,60	4,35	9,50	3,55	9,40	2,95
12	10,15	4,91	10,04	3,88	9,87	3,23
15	10,23	5,45	10,12	4,24	10,03	3,48
20	10,37	6,35	10,24	4,82	10,30	3,88
35					10,73	3,97
Performance with partial load						
Tbival (-7°C)	A	B	C	D		
Outdoor temperature	-7	2	7	12		
PLR - Climate load factor	0,88	0,54	0,35	0,15		
DC - Output with full load	5,85	7,80	9,60	10,15		
COP with full load	2,70	3,05	4,35	4,91		
COP with partial load	2,70	3,05	3,31	2,56		
CR - Load factor	1,00	0,46	0,24	0,10		
f COP - Corrective factor	1,00	1,00	0,76	0,52		

COOLING				
	Climate load factor	Outdoor temperature	EER	Nominal capacity
EER1	100%	35	2,90	7,40
EER2	75%	30	4,23	5,45
EER3	50%	25	6,10	3,51
EER4	25%	20	7,54	3,02

Heating

The performance values comply with Standards EN 14511 and EN 14825.
The performance values with a part load refer to a water delivery temperature of 35°C.

Cooling

The performance values comply with Standards EN 14825.

30AWH-P 012

HEATING						
Performance with full load						
CH flow temperature	35°C		45°C		55°C	
Outdoor temperature	Nominal capacity	COP	Nominal capacity	COP	Nominal capacity	COP
-7	8,10	2,71	7,86	2,56	7,70	2,02
2	8,90	3,35	8,42	2,91	8,35	2,30
7	11,40	4,55	10,80	3,65	10,95	3,10
12	11,89	5,86	11,26	4,47	11,29	3,49
15	12,02	6,86	11,55	5,03	11,60	3,84
20	12,22	8,53	12,05	5,98	12,12	4,42
35					13,20	4,60
Performance with partial load						
Tbival (-7°C)	A	B	C	D		
Outdoor temperature	-7	2	7	12		
PLR - Climate load factor	0,88	0,54	0,35	0,15		
DC - Output with full load	8,10	8,90	11,40	11,89		
COP with full load	2,70	3,35	4,55	5,86		
COP with partial load	2,70	3,35	4,55	3,33		
CR - Load factor	1,00	0,56	0,28	0,12		
f COP - Corrective factor	1,00	1,00	1,00	0,57		

COOLING				
	Climate load factor	Outdoor temperature	EER	Nominal capacity
EER1	100%	35	3,05	9,70
EER2	75%	30	4,49	7,15
EER3	50%	25	5,96	4,59
EER4	25%	20	8,31	3,60

Heating

The performance values comply with Standards EN 14511 and EN 14825.
The performance values with a part load refer to a water delivery temperature of 35°C.

Cooling

The performance values comply with Standards EN 14825.

30AWH-P 014

HEATING						
Performance with full load						
CH flow temperature	35°C		45°C		55°C	
Outdoor temperature	Nominal capacity	COP	Nominal capacity	COP	Nominal capacity	COP
-7	8,10	2,75	7,86	2,37	7,70	2,06
2	8,90	3,45	8,42	2,92	8,35	2,35
7	13,80	4,30	13,60	3,40	13,25	2,90
12	14,14	5,34	13,93	4,15	13,74	3,31
15	14,17	6,25	13,96	4,68	13,87	3,64
20	14,22	7,75	14,01	5,58	14,09	4,20
35					15,15	4,50
Performance with partial load						
Tbival (-7°C)	A	B	C	D		
Outdoor temperature	-7	2	7	12		
PLR - Climate load factor	0,88	0,54	0,35	0,15		
DC - Output with full load	8,10	8,90	13,80	14,14		
COP with full load	2,75	3,45	4,30	5,34		
COP with partial load	2,75	3,45	4,30	2,78		
CR - Load factor	1,00	0,56	0,23	0,10		
f COP - Corrective factor	1,00	1,00	1,00	0,52		

COOLING				
	Climate load factor	Outdoor temperature	EER	Nominal capacity
EER1	100%	35	2,95	10,70
EER2	75%	30	4,07	7,88
EER3	50%	25	5,91	5,07
EER4	25%	20	8,04	3,63

Heating

The performance values comply with Standards EN 14511 and EN 14825.

The performance values with a part load refer to a water delivery temperature of 35°C.

Cooling

The performance values comply with Standards EN 14825.

30AWH-P 012T

HEATING						
Performance with full load						
CH flow temperature	35°C		45°C		55°C	
Outdoor temperature	Nominal capacity	COP	Nominal capacity	COP	Nominal capacity	COP
-7	8,10	2,71	7,86	2,56	7,70	2,02
2	9,40	3,20	9,00	2,84	8,80	2,20
7	11,40	4,65	10,80	3,75	10,95	3,15
12	11,89	5,98	11,26	4,55	11,29	3,56
15	12,02	7,00	11,55	5,14	11,60	3,92
20	12,22	8,70	12,05	6,10	12,12	4,51
35					13,20	4,69
Performance with partial load						
Tbival (-7°C)	A	B	C	D		
Outdoor temperature	-7	2	7	12		
PLR - Climate load factor	0,88	0,54	0,35	0,15		
DC - Output with full load	8,10	9,40	11,40	11,89		
COP with full load	2,70	3,20	4,65	5,98		
COP with partial load	2,70	3,20	4,65	3,40		
CR - Load factor	1,00	0,53	0,28	0,12		
f COP - Corrective factor	1,00	1,00	1,00	0,57		

COOLING				
	Climate load factor	Outdoor temperature	EER	Nominal capacity
EER1	100%	35	3,10	9,70
EER2	75%	30	4,49	7,15
EER3	50%	25	5,96	4,59
EER4	25%	20	8,22	3,60

Heating

The performance values comply with Standards EN 14511 and EN 14825.
The performance values with a part load refer to a water delivery temperature of 35°C.

Cooling

The performance values comply with Standards EN 14825.

30AWH-P 014T

HEATING						
Performance with full load						
CH flow temperature	35°C		45°C		55°C	
Outdoor temperature	Nominal capacity	COP	Nominal capacity	COP	Nominal capacity	COP
-7	8,10	2,75	7,86	2,37	7,70	2,06
2	9,40	3,30	9,00	2,90	8,80	2,25
7	13,80	4,40	13,60	3,50	13,25	2,95
12	14,14	5,45	13,93	4,23	13,74	3,37
15	14,17	6,37	13,96	4,78	13,87	3,71
20	14,22	7,91	14,01	5,69	14,09	4,28
35					15,15	4,59
Performance with partial load						
Tbival (-7°C)	A	B	C	D		
Outdoor temperature	-7	2	7	12		
PLR - Climate load factor	0,88	0,54	0,35	0,15		
DC - Output with full load	8,10	9,40	13,80	14,14		
COP with full load	2,75	3,30	4,40	5,45		
COP with partial load	2,75	3,30	4,40	2,83		
CR - Load factor	1,00	0,53	0,23	0,10		
f COP - Corrective factor	1,00	1,00	1,00	0,52		

COOLING				
	Climate load factor	Outdoor temperature	EER	Nominal capacity
EER1	100%	35	3,00	10,70
EER2	75%	30	4,07	7,88
EER3	50%	25	5,91	5,07
EER4	25%	20	7,96	3,63

Heating

The performance values comply with Standards EN 14511 and EN 14825.
 The performance values with a part load refer to a water delivery temperature of 35°C.

Cooling

The performance values comply with Standards EN 14825.

PERFORMANCE DATA - HEATING CAPACITIES IN ACCORDANCE WITH EN14511

OUTSIDE AIR DRY-BULB (WET-BULB) TEMPERATURE: -20(-21) / -15(-16) °C

Outside air dry-bulb (wet-bulb) temperature (°C)																			
30AWH-P 004-014	LWT °C	-20(-21)						-15(-16)											
		Qh			COP			q			Qh			COP			q		
		kW			kW/kW			l/s			kW			kW/kW			l/s		
		Nom	Min	Max	Nom	Min	Max	Nom	Nom	Min	Max	Nom	Min	Max	Nom	Min	Max		
004	35	2,86	1,29	2,86	1,61	1,54	1,61	0,14	2,47	1,70	3,64	2,14	2,16	2,01	0,12				
006		3,34	1,60	3,34	2,08	2,03	2,08	0,16	3,61	2,04	5,94	2,47	2,44	2,22	0,17				
008		4,15	2,34	4,15	2,25	2,17	2,25	0,20	5,10	2,98	6,26	2,54	2,56	2,39	0,24				
010		4,15	2,34	4,15	2,25	2,17	2,25	0,20	5,10	2,98	6,26	2,54	2,56	2,39	0,24				
012		6,46	3,11	6,87	2,36	2,31	2,33	0,31	7,46	3,68	10,68	2,58	2,59	2,20	0,36				
012T		6,46	3,11	6,87	2,41	2,34	2,38	0,31	7,46	3,68	10,68	2,63	2,61	2,24	0,36				
014		6,46	3,11	6,87	2,36	2,31	2,33	0,31	7,46	3,68	10,68	2,58	2,59	2,20	0,36				
014T		6,46	3,11	6,87	2,41	2,34	2,38	0,31	7,46	3,68	10,68	2,63	2,61	2,24	0,36				
004	45	2,47	1,21	2,47	1,36	1,24	1,36	0,12	3,59	1,59	3,59	1,76	1,66	1,76	0,17				
006		3,30	1,47	3,30	1,78	1,58	1,78	0,16	4,00	1,87	5,76	1,95	1,90	1,87	0,19				
008		3,95	2,25	3,95	1,94	1,80	1,94	0,19	4,89	2,83	5,97	2,18	2,08	2,10	0,23				
010		3,95	2,25	3,95	1,94	1,80	1,94	0,19	4,89	2,83	5,97	2,18	2,08	2,10	0,23				
012		6,17	2,91	6,56	2,07	1,88	2,06	0,30	7,15	3,45	10,31	2,25	2,10	2,05	0,34				
012T		6,17	2,91	6,56	2,11	1,90	2,11	0,30	7,15	3,45	10,31	2,30	2,12	2,09	0,34				
014		6,17	2,91	6,56	2,07	1,88	2,06	0,30	7,15	3,45	10,31	2,25	2,10	2,05	0,34				
014T		6,17	2,91	6,56	2,11	1,90	2,11	0,30	7,15	3,45	10,31	2,30	2,12	2,09	0,34				
004	55	2,12	1,12	2,12	1,05	0,99	1,05	0,07	2,98	1,51	2,98	1,47	1,30	1,47	0,09				
006		2,77	1,40	2,77	1,53	1,28	1,53	0,12	3,45	1,81	4,62	1,76	1,56	1,70	0,12				
008		3,27	2,20	3,27	1,65	1,51	1,65	0,12	4,75	2,75	4,81	1,89	1,73	1,88	0,14				
010		3,27	2,20	3,27	1,65	1,51	1,65	0,12	4,75	2,75	4,81	1,89	1,73	1,88	0,14				
012		6,38	2,75	6,38	1,87	1,52	1,87	0,19	6,98	3,29	9,19	2,01	1,71	1,99	0,21				
012T		6,38	2,75	6,38	1,91	1,54	1,91	0,19	6,98	3,29	9,19	2,05	1,73	2,03	0,21				
014		6,38	2,75	6,38	1,87	1,52	1,87	0,19	6,98	3,29	9,19	2,01	1,71	1,99	0,21				
014T		6,38	2,75	6,38	1,91	1,54	1,91	0,19	6,98	3,29	9,19	2,05	1,73	2,03	0,21				
004	65								2,16	1,37	2,16	1,11	1,02	1,11	0,07				
006									2,38	1,71	2,38	1,43	1,28	1,43	0,12				
008									2,94	2,57	2,94	1,49	1,41	1,49	0,12				
010									2,94	2,57	2,94	1,49	1,41	1,49	0,12				
012									3,14	3,14	3,14	1,39	1,39	1,39	0,17				
012T									3,14	3,14	3,14	1,40	1,40	1,40	0,17				
014									3,14	3,14	3,14	1,39	1,39	1,39	0,17				
014T									3,14	3,14	3,14	1,40	1,40	1,40	0,17				
004	75																		
006																			
008																			
010																			
012																			
012T																			
014																			
014T																			

LEGEND

LWT Leaving water temperature (°C)
 Qh Heating capacity (kW)
 Nom Nominal
 Min Minimum
 Max Maximum
 COP Coefficient of Performance (kW/kW)
 q Condenser water flow rate (l/s)

APPLICATION DATA

Standard units, refrigerant: R290
 Condenser entering/leaving water temperature difference: according to NF414
 Condenser fluid: water
 Fouling factor: 0 m² K/W
 Performances in accordance with EN 14511

OUTSIDE AIR DRY-BULB (WET-BULB) TEMPERATURE: -10(-11) / -7(-8) °C

Outside air dry-bulb (wet-bulb) temperature (°C)															
30AWH-P 004+014	LWT °C	-10(-11)							-7(-8)						
		Qh			COP			q	Qh			COP			q
		kW			kW/kW			l/s	kW			kW/kW			l/s
		Nom	Min	Max	Nom	Min	Max	Nom	Nom	Min	Max	Nom	Min	Max	Nom
004	35	3,08	2,08	4,18	2,55	2,72	2,03	0,15	3,35	1,28	4,18	2,75	2,75	2,22	0,17
006		4,38	2,49	5,86	2,74	2,87	2,09	0,21	4,15	1,57	6,00	2,70	2,86	2,32	0,23
008		5,27	3,68	8,10	2,36	3,01	1,96	0,29	5,85	2,36	8,41	2,70	2,90	2,16	0,32
010		5,27	3,68	8,30	2,36	3,01	1,92	0,29	5,85	2,36	8,87	2,70	2,90	2,05	0,32
012		7,43	4,31	10,45	2,47	2,94	2,10	0,40	8,10	2,56	9,96	2,70	2,59	2,40	0,44
012T		7,43	4,31	10,45	2,57	2,97	2,15	0,40	8,10	2,56	9,96	2,75	2,59	2,44	0,44
014		7,43	4,31	10,45	2,47	2,94	2,10	0,40	8,10	2,56	10,94	2,70	2,59	2,22	0,44
014T		7,43	4,31	10,45	2,57	2,97	2,15	0,40	8,10	2,56	10,94	2,75	2,59	2,27	0,44
004	45	2,83	1,96	4,18	2,04	2,13	1,73	0,14	3,11	1,16	4,18	2,17	2,05	1,84	0,15
006		4,23	2,31	5,75	2,35	2,23	2,13	0,20	4,02	1,38	6,00	2,49	2,09	2,27	0,22
008		5,10	3,46	7,60	2,25	2,40	1,96	0,28	5,58	2,20	7,85	2,53	2,21	2,16	0,30
010		5,10	3,46	7,95	2,25	2,40	1,91	0,28	5,58	2,20	8,58	2,53	2,21	2,04	0,30
012		7,30	4,05	10,19	2,42	2,37	2,16	0,39	7,86	2,34	9,72	2,56	2,02	2,37	0,42
012T		7,30	4,05	10,19	2,24	2,40	2,01	0,39	7,86	2,34	9,72	2,37	2,02	2,20	0,42
014		7,30	4,05	10,19	2,42	2,37	2,16	0,39	7,86	2,34	10,66	2,56	2,02	2,26	0,42
014T		7,30	4,05	10,19	2,24	2,40	2,01	0,39	7,86	2,34	10,66	2,37	2,02	2,10	0,42
004	55	2,70	1,88	4,18	1,65	1,65	1,50	0,08	3,05	1,06	4,18	1,85	1,51	1,60	0,09
006		4,00	2,24	5,54	1,78	1,82	1,64	0,12	4,00	1,28	5,94	1,90	1,63	1,70	0,14
008		4,98	3,34	6,68	1,74	1,96	1,64	0,17	5,45	2,09	7,46	1,93	1,72	1,79	0,18
010		4,98	3,34	7,17	1,74	1,96	1,60	0,17	5,45	2,09	8,21	1,93	1,72	1,72	0,18
012		7,26	3,87	10,04	1,88	1,93	1,82	0,24	7,70	2,17	9,50	2,02	1,57	1,94	0,26
012T		7,26	3,87	10,04	1,96	1,95	1,86	0,24	7,70	2,17	9,50	2,06	1,57	1,98	0,26
014		7,26	3,87	10,04	1,92	1,93	1,82	0,24	7,70	2,17	10,52	2,02	1,57	1,89	0,26
014T		7,26	3,87	10,04	1,96	1,95	1,86	0,24	7,70	2,17	10,52	2,06	1,57	1,93	0,26
004	65	4,26	1,76	4,26	1,52	1,27	1,52	0,10	2,87	1,99	4,10	1,58	1,41	1,58	0,10
006		4,60	2,14	4,95	1,64	1,52	1,61	0,12	3,76	2,38	4,68	1,54	1,64	1,54	0,13
008		5,28	3,14	5,66	1,74	1,59	1,73	0,13	5,12	3,55	5,12	1,67	1,73	1,67	0,14
010		5,28	3,14	5,66	1,74	1,59	1,73	0,13	5,12	3,55	5,12	1,67	1,73	1,67	0,14
012		6,74	3,67	6,74	1,81	1,54	1,81	0,17	7,61	4,01	8,51	1,76	1,64	1,74	0,21
012T		6,74	3,67	6,74	1,86	1,56	1,86	0,17	7,61	4,01	8,51	1,82	1,66	1,79	0,21
014		6,74	3,67	6,74	1,81	1,54	1,81	0,17	7,61	4,01	8,51	1,76	1,64	1,74	0,21
014T		6,74	3,67	6,74	1,86	1,56	1,86	0,17	7,61	4,01	8,51	1,82	1,66	1,79	0,21
004	75								2,26	1,64	2,26	1,05	1,03	1,05	0,07
006									2,52	2,23	2,52	1,35	1,42	1,35	0,12
008									3,00	3,00	3,00	1,33	1,33	1,33	0,12
010									3,00	3,00	3,00	1,33	1,33	1,33	0,12
012									3,79	3,79	3,79	1,30	1,30	1,30	0,17
012T									3,79	3,79	3,79	1,31	1,31	1,31	0,17
014									3,79	3,79	3,79	1,30	1,30	1,30	0,17
014T									3,79	3,79	3,79	1,31	1,31	1,31	0,17

LEGEND

- LWT Leaving water temperature (°C)
- Qh Heating capacity (kW)
- Nom Nominal
- Min Minimum
- Max Maximum
- COP Coefficient of Performance (kW/kW)
- q Condenser water flow rate (l/s)

APPLICATION DATA

- Standard units, refrigerant: R290
- Condenser entering/leaving water temperature difference: according to NF414
- Condenser fluid: water
- Fouling factor: 0 m² K/W
- Performances in accordance with EN 14511

OUTSIDE AIR DRY-BULB (WET-BULB) TEMPERATURE: 2(1) / 7(6) °C

Outside air dry-bulb (wet-bulb) temperature (°C)															
30AWH-P 004:014	LWT °C	2(1)						7(6)							
		Qh			COP			q	Qh			COP			q
		kW			kW/kW			l/s	kW			kW/kW			l/s
		Nom	Min	Max	Nom	Min	Max	Nom	Nom	Min	Max	Nom	Min	Max	Nom
004	35	3,75	1,32	4,07	3,70	3,69	3,47	0,20	3,95	1,50	4,80	4,90	4,90	4,35	0,19
006		4,65	1,65	5,14	3,70	3,76	3,23	0,26	5,80	1,87	7,20	4,90	4,93	4,31	0,29
008		7,00	2,53	7,62	3,50	3,84	3,19	0,40	7,60	2,74	8,47	4,80	4,93	4,10	0,37
010		7,80	2,44	8,72	3,05	3,68	2,42	0,51	9,60	2,74	10,00	4,35	4,93	3,40	0,46
012		8,90	2,62	11,14	3,35	3,04	2,95	0,54	11,40	3,00	12,92	4,55	4,80	3,88	0,55
012T		8,90	2,62	11,14	3,45	3,04	3,01	0,54	11,40	3,00	12,92	4,65	4,80	3,96	0,55
014		9,40	2,63	11,93	3,20	3,04	2,58	0,59	13,80	3,00	14,82	4,30	4,80	3,42	0,67
014T		9,40	2,63	11,93	3,30	3,04	2,63	0,59	13,80	3,00	14,82	4,40	4,80	3,48	0,67
004	45	3,49	1,18	4,27	2,91	2,66	2,80	0,18	3,85	1,34	4,80	3,65	3,40	3,39	0,19
006		4,58	1,46	5,14	3,14	2,73	2,90	0,25	5,50	1,69	7,20	3,65	3,47	3,34	0,27
008		7,13	2,27	7,62	3,05	2,75	2,82	0,41	7,80	2,57	8,47	3,75	3,47	3,28	0,38
010		7,71	2,27	8,72	2,75	2,75	2,30	0,49	9,50	2,57	10,00	3,55	3,47	2,81	0,45
012		8,42	2,36	11,14	2,91	2,31	2,56	0,51	10,80	2,68	12,92	3,65	3,42	3,16	0,52
012T		8,42	2,36	11,14	2,92	2,31	2,58	0,51	10,80	2,68	12,92	3,75	3,42	3,20	0,52
014		9,00	2,36	11,70	2,84	2,30	2,49	0,56	13,60	2,68	14,82	3,40	3,42	2,88	0,68
014T		9,00	2,36	11,70	2,90	2,30	2,54	0,56	13,60	2,68	14,82	3,50	3,42	2,92	0,68
004	55	3,55	1,05	4,37	2,40	1,96	2,37	0,11	3,75	1,20	4,80	2,95	2,38	2,74	0,12
006		4,45	1,34	5,14	2,45	2,06	2,22	0,15	5,25	1,56	7,20	2,95	2,56	2,73	0,16
008		7,00	2,16	7,62	2,45	2,11	2,26	0,25	7,55	2,47	8,47	3,15	2,53	2,70	0,23
010		7,80	2,16	8,55	2,15	2,11	1,94	0,30	9,40	2,47	10,00	2,95	2,53	2,39	0,28
012		8,35	2,16	11,14	2,30	1,77	2,07	0,31	10,95	2,45	14,40	3,10	2,50	2,68	0,33
012T		8,35	2,16	11,14	2,35	1,77	2,27	0,31	10,95	2,45	14,40	3,15	2,50	2,74	0,33
014		8,80	2,16	11,40	2,20	1,77	1,99	0,34	13,25	2,45	14,66	2,90	2,50	2,50	0,40
014T		8,80	2,16	11,40	2,25	1,77	2,16	0,34	13,25	2,45	14,66	2,95	2,50	2,55	0,40
004	65	3,47	2,53	4,48	1,94	1,83	1,88	0,08	3,36	2,81	4,80	2,20	2,11	2,16	0,08
006		4,83	3,12	5,04	2,12	2,03	1,89	0,12	4,87	3,50	7,20	2,38	2,33	2,30	0,12
008		6,75	4,66	7,41	2,07	2,09	1,97	0,19	7,06	5,24	9,60	2,46	2,40	2,30	0,17
010		7,56	4,66	7,61	1,94	2,09	1,92	0,22	8,90	5,24	9,72	2,38	2,40	2,22	0,21
012		8,32	5,15	9,63	1,96	2,01	1,89	0,25	10,32	5,64	13,78	2,42	2,40	2,29	0,25
012T		8,32	5,15	9,63	2,10	2,03	2,05	0,25	10,32	5,64	13,78	2,49	2,42	2,36	0,25
014		8,56	5,15	9,36	1,98	2,01	1,93	0,26	12,61	5,64	13,78	2,35	2,40	2,29	0,30
014T		8,56	5,15	9,36	2,04	2,03	1,99	0,26	12,61	5,64	13,78	2,42	2,42	2,36	0,30
004	75	4,09	2,15	4,09	1,47	1,28	1,47	0,10	3,29	2,43	4,36	1,55	1,47	1,54	0,10
006		4,49	2,87	5,49	1,84	1,73	1,83	0,12	4,77	3,18	6,20	2,04	1,95	2,04	0,15
008		5,98	3,99	6,17	1,69	1,61	1,69	0,16	6,90	4,58	8,12	1,92	1,84	1,92	0,16
010		6,16	3,99	6,16	1,68	1,61	1,69	0,17	7,80	4,58	8,12	1,93	1,84	1,92	0,19
012		7,58	4,82	7,58	1,65	1,57	1,65	0,23	10,11	5,24	10,68	1,92	1,83	1,92	0,25
012T		7,58	4,82	7,58	1,70	1,58	1,70	0,23	10,11	5,24	10,68	1,97	1,84	1,97	0,25
014		7,58	4,82	7,58	1,65	1,57	1,65	0,23	12,36	5,24	10,68	1,92	1,83	1,92	0,25
014T		7,58	4,82	7,58	1,70	1,58	1,70	0,23	12,36	5,24	10,68	1,97	1,84	1,97	0,25

LEGEND

- LWT Leaving water temperature (°C)
- Qh Heating capacity (kW)
- Nom Nominal
- Min Minimum
- Max Maximum
- COP Coefficient of Performance (kW/kW)
- q Condenser water flow rate (l/s)

APPLICATION DATA

- Standard units, refrigerant: R290
- Condenser entering/leaving water temperature difference: according to NF414
- Condenser fluid: water
- Fouling factor: 0 m² K/W
- Performances in accordance with EN 14511

OUTSIDE AIR DRY-BULB (WET-BULB) TEMPERATURE: 10(9) / 20(19) °C

Outside air dry-bulb (wet-bulb) temperature (°C)															
30AWH-P 004-014	LWT °C	10(9)						20(19)							
		Qh			COP			q	Qh			COP			q
		kW			kW/kW			l/s	kW			kW/kW			l/s
		Nom	Min	Max	Nom	Min	Max	Nom	Nom	Min	Max	Nom	Min	Max	Nom
004	35	4,05	1,64	4,80	5,07	5,38	4,78	0,19	4,27	2,18	4,80	7,06	7,74	6,80	0,20
006		5,90	2,03	7,20	5,08	5,50	4,73	0,28	6,35	2,59	7,20	7,12	7,98	6,75	0,30
008		7,88	2,98	9,60	5,21	5,58	4,67	0,38	8,57	3,98	9,60	7,39	8,87	7,01	0,41
010		10,09	2,98	10,00	4,55	5,58	3,91	0,48	10,37	3,98	12,00	6,35	8,87	5,84	0,50
012		11,81	3,30	14,40	5,19	5,48	4,59	0,57	12,22	4,69	14,40	8,53	9,23	7,60	0,59
012T		11,81	3,30	14,40	5,30	5,48	4,68	0,57	12,22	4,69	14,40	8,70	9,23	7,75	0,59
014		14,11	3,30	16,80	4,74	5,48	4,06	0,68	14,22	4,69	16,80	7,75	9,23	6,63	0,68
014T		14,11	3,30	16,80	4,83	5,48	4,14	0,68	14,22	4,69	16,80	7,91	9,23	6,76	0,68
004	45	3,98	1,46	4,80	3,87	3,68	3,68	0,19	3,98	1,94	4,80	4,98	4,88	4,78	0,19
006		5,55	1,85	7,20	3,82	3,82	3,59	0,27	6,10	2,37	7,20	5,16	5,20	4,87	0,29
008		7,93	2,82	9,60	3,98	3,88	3,62	0,38	8,41	3,82	9,60	5,50	5,84	5,12	0,40
010		9,99	2,82	10,00	3,65	3,88	3,18	0,48	10,24	3,82	12,00	4,82	5,84	4,30	0,49
012		11,06	2,94	14,40	4,09	3,81	3,60	0,53	12,05	4,12	14,40	5,98	5,94	5,40	0,58
012T		11,06	2,94	14,40	4,17	3,81	3,67	0,53	12,05	4,12	14,40	6,10	5,94	5,51	0,58
014		13,91	2,94	16,80	3,79	3,81	3,28	0,65	14,01	4,12	16,80	5,58	5,94	4,81	0,67
014T		13,91	2,94	16,80	3,86	3,81	3,35	0,68	14,01	4,12	16,80	5,69	5,94	4,91	0,67
004	55	3,75	1,30	4,80	3,00	2,55	2,93	0,11	3,90	1,70	4,80	3,68	3,24	3,58	0,12
006		5,39	1,70	7,20	3,06	2,79	2,90	0,16	6,16	2,22	7,20	3,86	3,72	3,71	0,18
008		7,85	2,72	9,60	3,23	2,81	2,93	0,23	8,34	3,72	9,60	4,24	4,09	3,96	0,25
010		9,76	2,72	12,00	3,07	2,81	2,65	0,29	10,30	3,72	12,00	3,88	4,09	3,48	0,31
012		11,09	2,68	14,40	3,26	2,77	2,92	0,33	12,12	3,70	14,40	4,42	4,12	4,06	0,36
012T		11,09	2,68	14,40	3,33	2,77	2,98	0,34	12,12	3,70	14,40	4,51	4,12	4,14	0,36
014		13,65	2,68	16,80	3,08	2,77	2,76	0,41	14,09	3,70	16,80	4,20	4,12	3,74	0,42
014T		13,65	2,68	16,80	3,14	2,77	2,81	0,41	14,09	3,70	16,80	4,28	4,12	3,82	0,42
004	65	3,53	2,97	4,80	2,30	2,21	2,30	0,08	4,33	3,84	4,80	2,76	2,71	2,76	0,10
006		5,10	3,71	7,20	2,50	2,47	2,41	0,12	6,34	4,70	7,20	3,03	3,09	2,96	0,15
008		7,45	5,53	9,60	2,57	2,55	2,43	0,18	7,89	6,98	9,60	3,25	3,18	3,00	0,19
010		9,25	5,53	11,41	2,50	2,55	2,31	0,22	9,81	6,99	12,00	3,08	3,18	2,68	0,23
012		10,65	6,05	14,40	2,61	2,57	2,46	0,25	12,16	7,97	14,40	3,33	3,47	3,13	0,29
012T		10,65	6,05	14,40	2,69	2,60	2,53	0,25	12,16	7,97	14,40	3,39	3,51	3,22	0,29
014		13,24	6,05	14,64	2,54	2,57	2,48	0,32	13,76	7,97	16,80	3,23	3,47	2,92	0,33
014T		13,24	6,05	14,64	2,61	2,60	2,56	0,32	13,76	7,97	16,80	3,33	3,51	3,00	0,33
004	75	4,19	2,67	4,71	1,71	1,59	1,70	0,10	4,19	3,58	4,80	2,10	2,03	2,06	0,10
006		4,70	3,37	6,44	2,13	2,06	2,10	0,12	5,92	4,29	7,20	2,58	2,56	2,53	0,14
008		6,65	4,87	8,61	2,06	1,96	2,02	0,16	8,23	6,47	9,60	2,46	2,51	2,34	0,20
010		8,31	4,87	8,61	2,06	1,96	2,02	0,20	10,03	6,47	10,37	2,34	2,51	2,28	0,24
012		11,32	5,58	11,32	2,07	1,94	2,07	0,27	12,01	7,32	13,78	2,47	2,59	2,43	0,29
012T		11,32	5,58	11,32	2,13	1,96	2,13	0,24	12,01	7,32	13,78	2,55	2,61	2,50	0,29
014		11,32	5,58	11,32	2,07	1,94	2,07	0,27	13,79	7,31	13,78	2,43	2,59	2,43	0,33
014T		11,32	5,58	11,32	2,13	1,96	2,13	0,27	13,79	7,31	13,78	2,50	2,61	2,50	0,33

LEGEND

- LWT Leaving water temperature (°C)
- Qh Heating capacity (kW)
- Nom Nominal
- Min Minimum
- Max Maximum
- COP Coefficient of Performance (kW/kW)
- q Condenser water flow rate (l/s)

APPLICATION DATA

- Standard units, refrigerant: R290
- Condenser entering/leaving water temperature difference: according to NF414
- Condenser fluid: water
- Fouling factor: 0 m² K/W
- Performances in accordance with EN 14511

PERFORMANCE DATA - COOLING CAPACITIES IN ACCORDANCE WITH EN14511

OUTSIDE AIR TEMPERATURE: 10 / 15 / 25 °C

		Outside air Temperature, °C																				
30AWH-P 004÷014	LWT °C	10							15							25						
		Qc			EER			q	Qc			EER			q	Qc			EER			q
		kW			kW/kW			l/s	kW			kW/kW			l/s	kW			kW/kW			l/s
		Nom	Min	Max	Nom	Min	Max	Nom	Nom	Min	Max	Nom	Min	Max	Nom	Nom	Min	Max	Nom	Min	Max	Nom
004	5	384	215	480	713	937	576	0.18	369	132	480	639	787	492	0.18	334	114	463	419	459	3.09	0.16
006		530	365	643	636	861	522	0.25	508	181	616	537	810	455	0.24	460	157	560	386	432	3.43	0.22
008		556	395	556	626	800	626	0.26	543	253	543	551	703	551	0.26	503	231	503	418	453	4.18	0.24
010		556	395	556	626	800	626	0.26	543	253	543	551	703	551	0.26	503	231	503	418	453	4.18	0.24
012		877	467	877	641	969	641	0.42	862	306	862	566	790	566	0.41	823	275	823	425	400	4.25	0.39
012T		877	467	877	647	969	654	0.42	862	306	862	572	790	577	0.41	823	275	823	429	400	4.29	0.39
014		877	467	877	641	969	641	0.42	862	306	862	566	790	566	0.41	823	275	823	425	400	4.25	0.39
014T		877	467	877	647	969	647	0.42	862	306	862	572	790	572	0.41	823	275	823	429	400	4.29	0.39
004	7	409	234	480	762	1057	641	0.19	393	144	480	684	908	542	0.19	357	125	480	445	517	3.19	0.17
006		610	430	720	729	1080	579	0.29	537	196	720	565	935	408	0.26	485	171	671	404	481	3.15	0.23
008		651	419	716	607	860	550	0.31	681	271	880	466	767	339	0.32	685	249	842	413	496	3.27	0.33
010		651	419	716	607	860	550	0.31	763	271	880	408	767	339	0.36	765	249	842	366	496	3.27	0.36
012		1068	499	1312	598	1054	461	0.51	1058	486	1298	535	848	413	0.50	1023	299	1271	407	441	3.36	0.49
012T		1068	499	1312	604	1054	470	0.51	1058	486	1298	541	848	421	0.50	1023	299	1271	411	441	3.43	0.49
014		1068	499	1312	598	1054	461	0.51	1298	486	1298	413	848	413	0.62	1271	299	1271	336	441	3.36	0.61
014T		1068	499	1312	604	1054	470	0.51	1298	486	1298	421	848	421	0.62	1271	299	1271	343	441	3.43	0.61
004	10	432	268	480	813	1298	705	0.21	416	163	480	727	1144	593	0.20	380	143	480	471	614	3.41	0.18
006		563	393	719	670	942	500	0.27	577	217	720	610	1128	485	0.28	522	190	716	435	553	3.34	0.25
008		776	459	880	587	975	520	0.37	777	422	880	548	756	495	0.37	743	281	880	434	572	3.53	0.35
010		884	459	917	524	975	496	0.42	880	422	1100	500	756	383	0.42	820	281	994	379	572	2.86	0.39
012		1176	551	1320	647	1252	552	0.56	1168	540	1320	576	975	520	0.56	1136	335	1320	434	492	3.77	0.54
012T		1176	551	1320	653	1252	563	0.56	1168	540	1320	582	975	531	0.56	1136	335	1320	439	492	3.85	0.54
014		1389	551	1438	519	1252	494	0.66	1378	540	1465	476	975	467	0.66	1394	335	1394	355	492	3.55	0.67
014T		1389	551	1438	530	1252	504	0.66	1378	540	1465	485	975	476	0.66	1394	335	1394	362	492	3.62	0.67
004	15	407	300	480	1081	1621	926	0.19	415	290	480	882	1224	760	0.20	417	264	480	510	692	4.40	0.20
006		596	495	720	1087	1372	782	0.28	654	257	720	693	1617	623	0.31	593	228	720	490	730	4.07	0.28
008		811	532	880	779	1192	724	0.39	804	515	880	696	968	645	0.38	829	341	880	467	740	4.37	0.40
010		1039	532	1078	599	1192	566	0.50	1011	515	1100	558	968	499	0.48	895	341	1100	400	740	3.06	0.43
012		1199	648	1320	824	1652	761	0.57	1210	831	1320	750	1034	686	0.58	1208	405	1320	530	636	4.85	0.58
012T		1199	648	1320	832	1652	776	0.57	1210	831	1320	757	1034	700	0.58	1208	405	1320	535	636	4.95	0.58
014		1376	648	1540	734	1652	618	0.66	1406	831	1540	629	1034	556	0.67	1393	405	1540	452	636	3.98	0.67
014T		1376	648	1540	741	1652	630	0.66	1406	831	1540	636	1034	567	0.67	1393	405	1540	457	636	4.05	0.67
004	18	417	328	480	1254	1895	1113	0.20	418	316	480	1018	1442	898	0.20	413	289	480	567	782	4.98	0.20
006		647	537	720	1196	1631	975	0.31	612	393	720	920	1213	734	0.29	598	252	718	562	874	4.67	0.29
008		823	565	880	922	1312	869	0.39	802	568	880	833	1107	767	0.38	815	376	880	548	842	5.05	0.39
010		1011	565	1100	733	1312	660	0.48	1012	568	1100	639	1107	568	0.48	908	376	1100	458	842	3.52	0.43
012		1229	710	1320	1009	1925	939	0.59	1196	917	1320	909	1160	809	0.57	1214	452	1320	603	753	5.56	0.58
012T		1229	710	1320	1019	1925	958	0.59	1196	917	1320	918	1160	826	0.57	1214	452	1320	609	753	5.67	0.58
014		1400	710	1540	875	1925	756	0.67	1401	917	1540	759	1160	682	0.67	1421	452	1540	513	753	4.60	0.68
014T		1400	710	1540	884	1925	763	0.67	1401	917	1540	766	1160	689	0.67	1421	452	1540	519	753	4.69	0.68

LEGEND

LWT Leaving water temperature (°C)
 Qc Cooling capacity (kW)
 Nom Nominal
 Min Minimum
 Max Maximum
 EER Energy Efficiency Ratio (kW/kW)
 q Condenser water flow rate (l/s)

APPLICATION DATA

Standard units, refrigerant: R290
 Evaporator entering/leaving water temperature difference: 5 K
 Evaporator fluid: water
 Fouling factor: 0 m² K/W
 Performances in accordance with EN 14511

OUTSIDE AIR TEMPERATURE: 35 / 45 °C

Outside air Temperature, °C															
30AWH-P 004-014	LWT °C	35						45							
		Qc			EER			q	Qc			EER			q
		kW			kW/kW			l/s	kW			kW/kW			l/s
		Nom	Min	Max	Nom	Min	Max	Nom	Nom	Min	Max	Nom	Min	Max	Nom
004	5	2,91	0,93	4,37	2,88	2,54	2,05	0,14	2,48	0,72	3,85	2,06	1,56	1,52	0,12
006		4,17	1,33	5,04	2,89	2,59	2,58	0,20	3,66	1,09	4,32	2,15	1,77	1,84	0,17
008		5,71	2,03	5,71	2,70	2,66	2,70	0,27	5,16	1,75	5,80	2,16	1,96	2,01	0,25
010		5,71	2,03	5,71	2,70	2,66	2,70	0,27	5,79	1,75	5,79	2,00	1,96	2,00	0,28
012		8,79	2,43	8,79	2,95	2,46	2,95	0,42	7,99	2,09	9,02	2,29	1,81	2,13	0,38
012T		8,79	2,43	8,79	3,01	2,46	3,03	0,42	7,99	2,09	9,02	2,33	1,81	2,20	0,38
014		8,79	2,43	8,79	2,95	2,46	2,95	0,42	9,02	2,09	9,02	2,13	1,81	2,13	0,43
014T		8,79	2,43	8,79	3,01	2,46	3,01	0,42	9,02	2,09	9,02	2,17	1,81	2,18	0,43
004	7	3,35	1,03	4,54	3,15	2,81	2,09	0,16	2,67	0,82	4,00	2,20	1,78	1,57	0,13
006		4,60	1,45	5,24	3,15	2,85	2,66	0,22	3,84	1,20	4,53	2,23	1,95	1,91	0,18
008		6,50	2,20	8,52	3,05	2,89	2,17	0,31	5,48	1,97	6,58	2,26	2,20	1,90	0,26
010		7,40	2,20	8,52	2,90	2,89	2,17	0,35	6,02	1,97	6,31	2,06	2,20	1,74	0,29
012		9,70	2,66	11,81	3,05	2,69	2,62	0,46	8,66	2,31	10,70	2,41	1,99	2,04	0,41
012T		9,70	2,66	11,81	3,10	2,69	2,70	0,46	8,66	2,31	10,70	2,45	1,99	2,11	0,41
014		10,70	2,66	11,81	2,95	2,69	2,62	0,51	10,70	2,31	10,70	2,04	1,99	2,04	0,51
014T		10,70	2,66	11,81	3,00	2,69	2,70	0,51	10,70	2,31	10,70	2,11	1,99	2,11	0,51
004	10	3,34	1,20	4,70	3,26	3,34	2,15	0,16	2,89	0,98	4,17	2,35	2,12	1,62	0,14
006		4,68	1,62	6,35	3,19	3,23	2,50	0,22	4,10	1,35	5,55	2,33	2,20	1,87	0,20
008		6,59	2,55	8,80	3,10	3,41	2,23	0,31	5,76	2,24	7,63	2,33	2,50	1,79	0,27
010		7,18	2,55	8,89	2,78	3,41	2,19	0,34	6,42	2,24	7,89	2,15	2,50	1,70	0,31
012		10,51	3,00	12,81	3,30	3,05	2,72	0,50	9,47	2,64	11,39	2,52	2,24	2,08	0,45
012T		10,51	3,00	12,81	3,37	3,05	2,80	0,50	9,47	2,64	11,39	2,57	2,24	2,14	0,45
014		12,81	3,00	12,81	2,72	3,05	2,72	0,61	11,39	2,64	11,39	2,08	2,24	2,08	0,54
014T		12,81	3,00	12,81	2,80	3,05	2,80	0,61	11,39	2,64	11,39	2,14	2,24	2,14	0,54
004	15	3,72	1,57	4,80	3,54	4,62	2,76	0,18	3,26	1,31	4,80	2,58	2,89	1,79	0,16
006		5,33	1,97	7,09	3,57	4,07	2,69	0,25	4,68	1,67	6,25	2,60	2,74	2,03	0,22
008		7,38	3,09	8,80	3,38	4,24	2,78	0,35	6,58	2,72	8,38	2,57	3,08	1,94	0,31
010		8,10	3,09	9,88	3,03	4,24	2,32	0,39	7,19	2,72	8,69	2,31	3,08	1,78	0,34
012		12,07	3,69	13,20	3,58	3,82	3,18	0,58	10,58	3,30	11,91	2,65	2,78	2,06	0,51
012T		12,07	3,69	13,20	3,65	3,82	3,27	0,58	10,58	3,30	11,91	2,71	2,78	2,12	0,51
014		14,17	3,69	14,17	2,83	3,82	2,83	0,68	11,91	3,30	11,91	2,06	2,78	2,06	0,57
014T		14,17	3,69	14,17	2,92	3,82	2,92	0,68	11,91	3,30	11,91	2,12	2,78	2,12	0,57
004	18	4,00	1,76	4,80	4,15	5,41	3,42	0,19	3,23	1,49	4,80	2,77	3,34	2,07	0,15
006		6,15	2,19	7,20	3,90	4,68	3,09	0,29	5,63	1,87	6,66	2,53	3,11	2,11	0,27
008		8,00	3,41	8,80	4,00	4,74	3,71	0,38	7,07	3,00	8,77	2,72	3,41	2,05	0,34
010		8,90	3,41	10,50	3,70	4,74	2,40	0,42	7,29	3,00	9,12	2,60	3,41	1,82	0,35
012		12,00	4,15	13,20	4,30	4,37	3,86	0,57	10,80	3,74	12,24	2,46	3,14	2,05	0,52
012T		12,00	4,15	13,20	4,35	4,37	3,94	0,57	10,80	3,74	12,24	2,51	3,14	2,11	0,52
014		14,50	4,15	15,30	3,70	4,37	3,01	0,69	11,26	3,74	12,24	2,05	3,14	2,05	0,59
014T		14,50	4,15	15,30	3,75	4,37	3,10	0,69	12,24	3,74	12,24	2,11	3,14	2,11	0,59

LEGEND

- LWT Leaving water temperature (°C)
- Qc Cooling capacity (kW)
- Nom Nominal
- Min Minimum
- Max Maximum
- EER Energy Efficiency Ratio (kW/kW)
- q Condenser water flow rate (l/s)

APPLICATION DATA


- Standard units, refrigerant: R290
- Evaporator entering/leaving water temperature difference: 5 K
- Evaporator fluid: water
- Fouling factor: 0 m² K/W
- Performances in accordance with EN 14511

OPERATING RANGE


Cooling Cycle			
Evaporator Water Temperature	°C	Minimum	Maximum
Entering water temperature at start-up		6	30
Leaving water temperature during operation		4	20
Condenser Air Temperature	°C	Minimum	Maximum
Standard unit		10	46
Heating Cycle			
Condenser Water Temperature	°C	Minimum	Maximum
Entering water temperature at start-up		15	65
Leaving water temperature during operation		20	75
Evaporator Air Temperature	°C	Minimum	Maximum
Standard unit		-20 (1)	40

(1) For operation at outdoor ambient temperature below 0°C (heating mode), the water freeze protection should be available and according to the water installation, the water loop can be protected against freeze by the installer, using an anti-freeze solution or trace heater.


Cooling mode

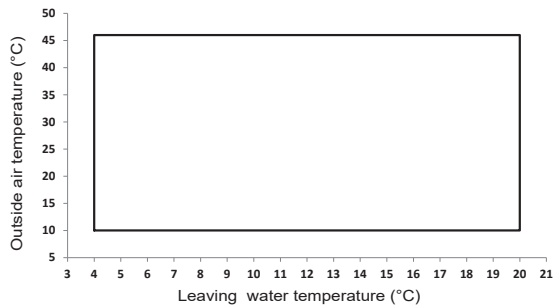

Heating mode

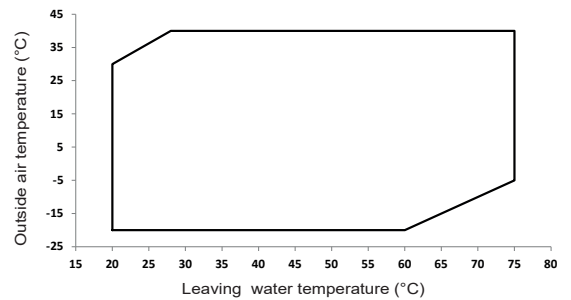

DIMENSIONS AND LOCATION OF HYDRAULIC CONNECTIONS

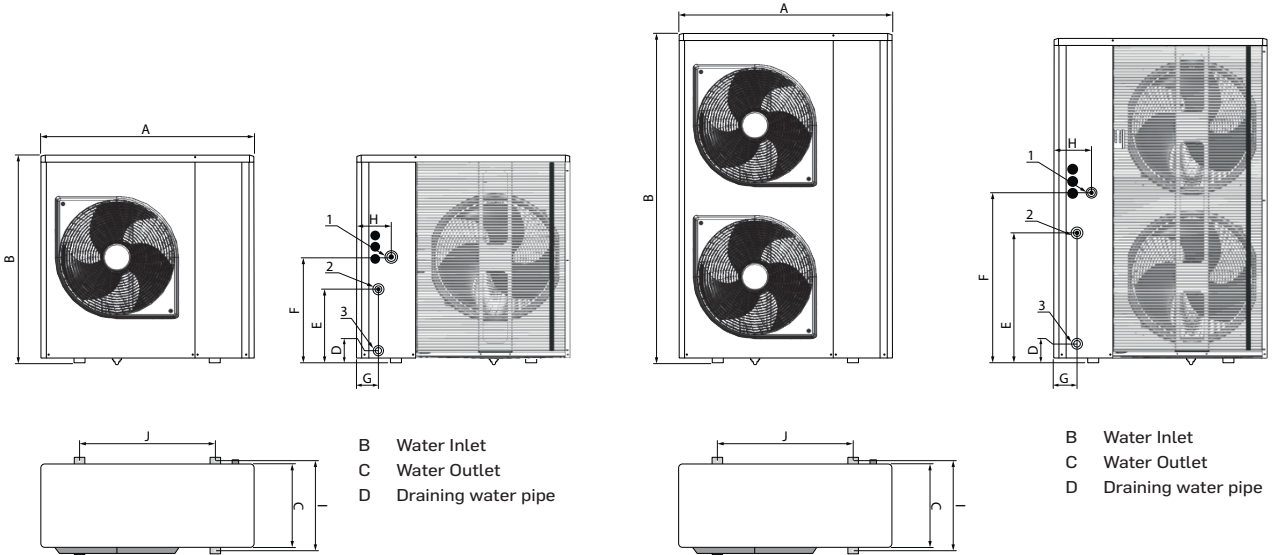

30AWH-P		A	B	C	D	E	F	G	H	I	J
004	mm	946	927	372	71	341	485	93	150	400	600
006	mm	946	927	372	71	341	485	93	150	400	600
008	mm	946	927	372	71	341	485	93	150	400	600
010	mm	946	927	372	71	341	485	93	150	400	600
012 / 012T	mm	946	1375	372	83	553	720	102	160	400	600
014 / 014T	mm	946	1375	372	83	553	720	102	160	400	600

PLACE OF INSTALLATION

This unit uses R290 refrigerant gas.

Do not attempt to replace this refrigerant with household propane.

The unit should be stored outdoors or in a controlled environment (R290 sensors and free from ignition sources area).

Units should not be stacked.

The unit should be installed so that refrigerant does not accumulate or stagnate in case of leakage (R290 refrigerant gas is heavier than air).

The unit should also be kept one meter away from any openings (doors, windows, etc.)


Refrigerant accumulation in an enclosed space can displace oxygen and cause asphyxiation or explosion.

In the event of a leak, the mixture of refrigerant and air can generate a flammable atmosphere.

Any source of ignition, such as open flames, hot surfaces (higher than 370 °C), or any potentially arcing devices (sockets, electrical switches, static discharges, etc.) must be kept at least one meter away from the unit.

Before positioning the unit (accessing the various components/opening the panel/replacement of components...) it is necessary to schedule the various maintenance tasks to be performed.


SERVICE SPACES TO ENSURE PROPER AIRFLOW

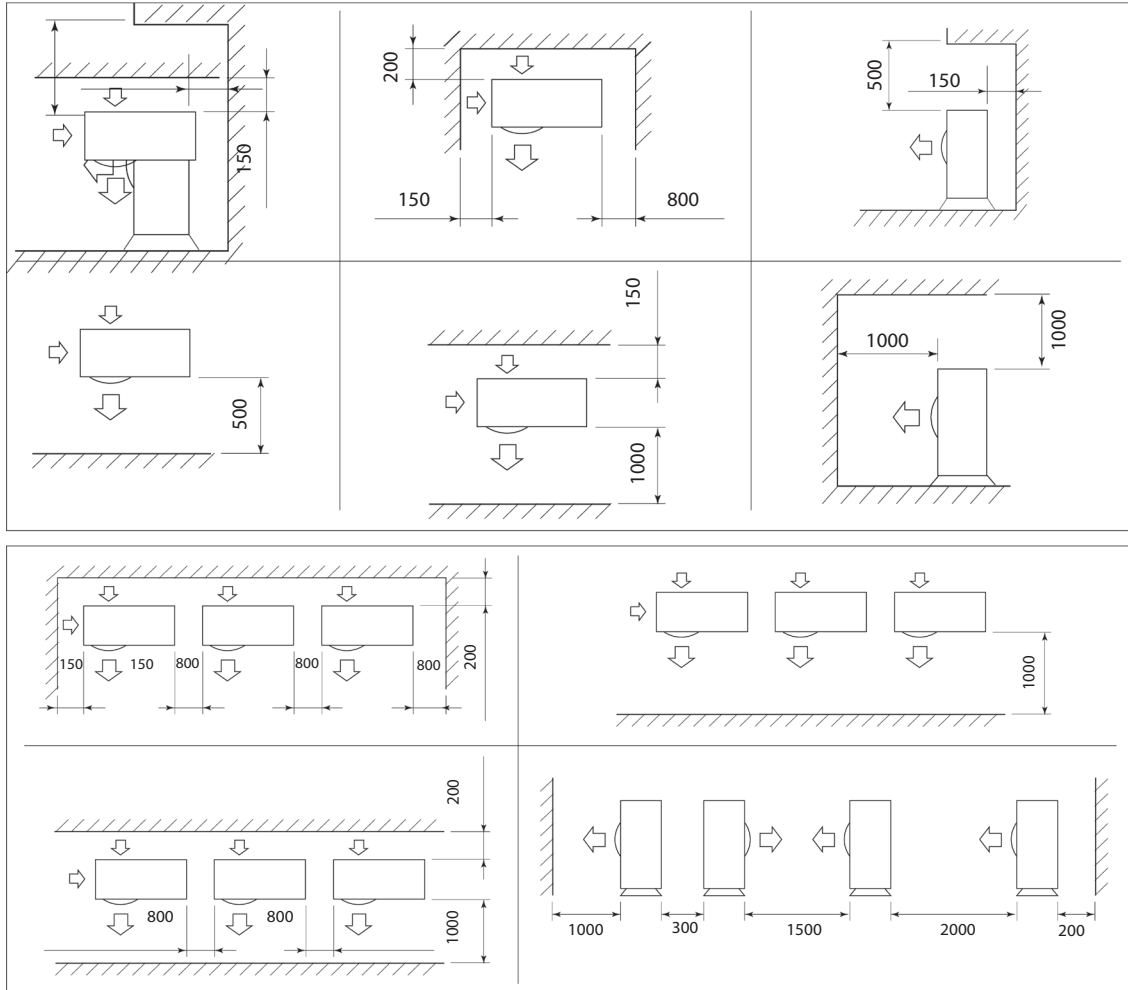

Anticipate different maintenance actions before to place the unit (access of different parts / opening of panel/ part replacement...)

HYDRAULIC MODULE

Hydraulic module equipped with variable speed single pump low available pressure

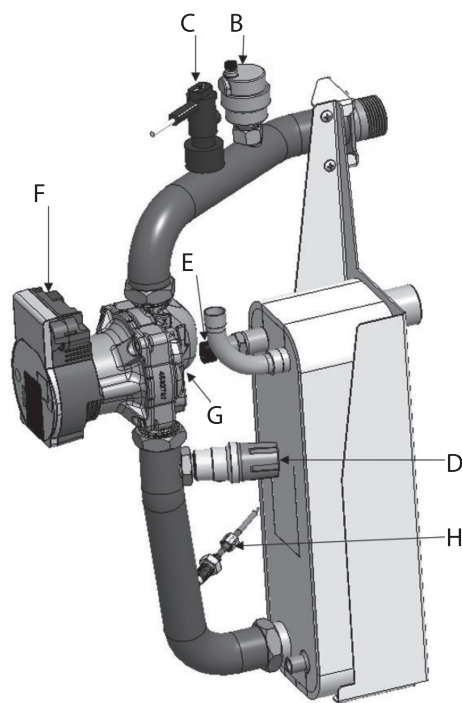


Legend

- B - Automatic purge valve
- C - Flow switch
- D - Safety valve outlet
- E - Leaving water temperature probe
- F - Circulation pump
- G - Plug to unblock the seizing pump
- H - Entering water temperature probe

Minimum and maximum pressures necessary in the hydraulic circuit for correct operation of the units.

Hydraulic circuit	Minimum pressure at the suction of the pump to avoid the cavitation phenomena	Maximum pressure at the suction of the pump before the opening of the water relief valve
Variable speed hydraulic module	110 kPa (1,1 bar)	300 kPa (3 bar)

HYDRAULIC CONNECTIONS

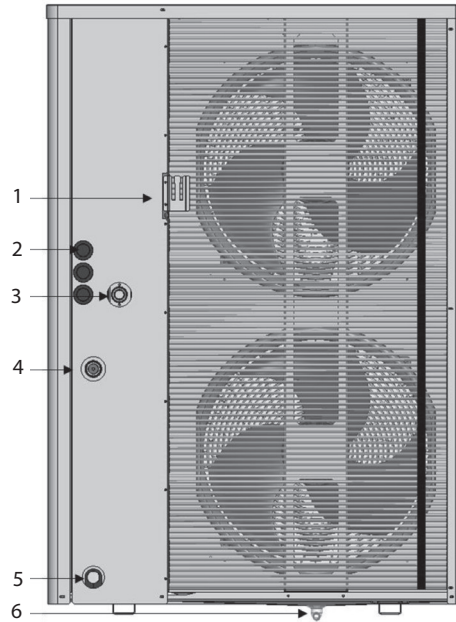

Legend

- 1 - Outside Air Temperature sensor
- 2 - Customer electrical connection
- 3 - Water inlet
- 4 - Water outlet
- 5 - Water drain pipe
- 6 - Condensate draining pipe

Water connections								
Model	30AWH-P							
	004	006	008	010	012	014	012T	014T
Diameter	1"	1"	1"	1"	1"	1"	1"	1"


AVAILABLE EXTERNAL STATIC PRESSURE

Data applicable for fresh water application (20°C). If glycol is used, the maximum water flow is reduced.


Model	UM	30AWH-P							
		004	006	008	010	012	014	012T	014T
Nominal delivery	m ³ /h	0,68	1,00	1,31	1,66	1,97	2,38	1,97	2,38
Useful head at nominal flow rate	kPa	83	82	70	57	100	82	100	82

(1) External air temperature 7°C BS, 6°C BU; Inlet/Outlet Water 30/35°C.


Available static pressure 30AWH-P 004

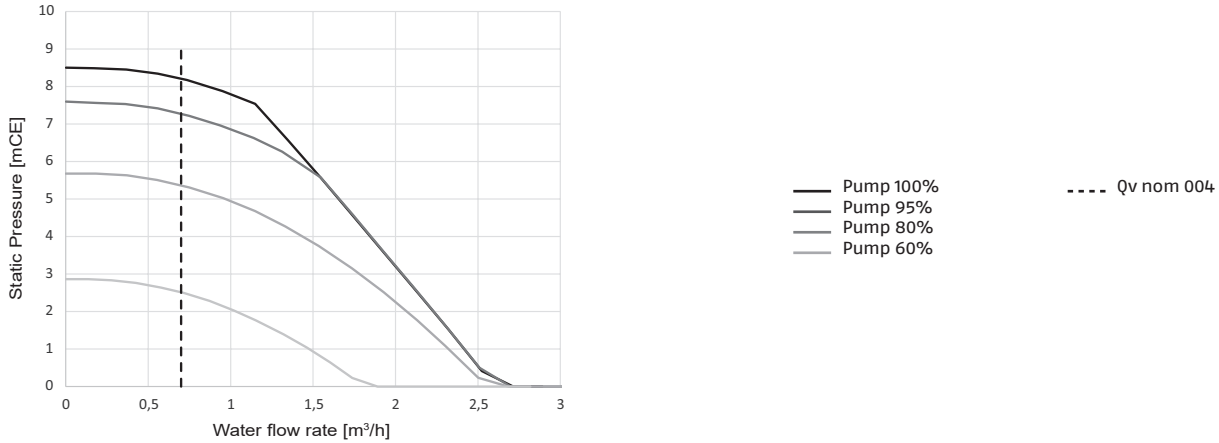

Available static pressure 30AWH-P 006-008-010

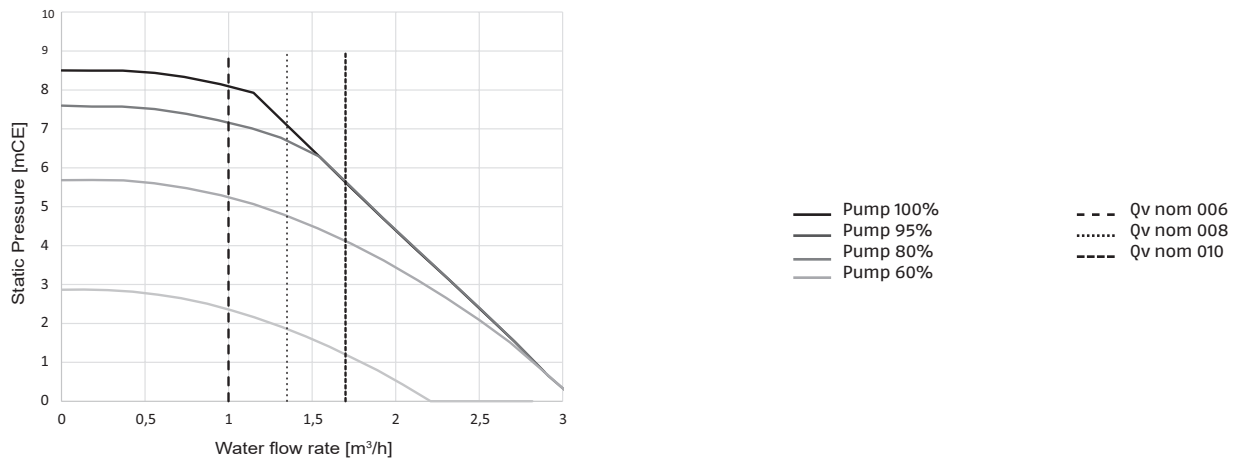

Available static pressure 30AWH-P 012-014-012T-014T

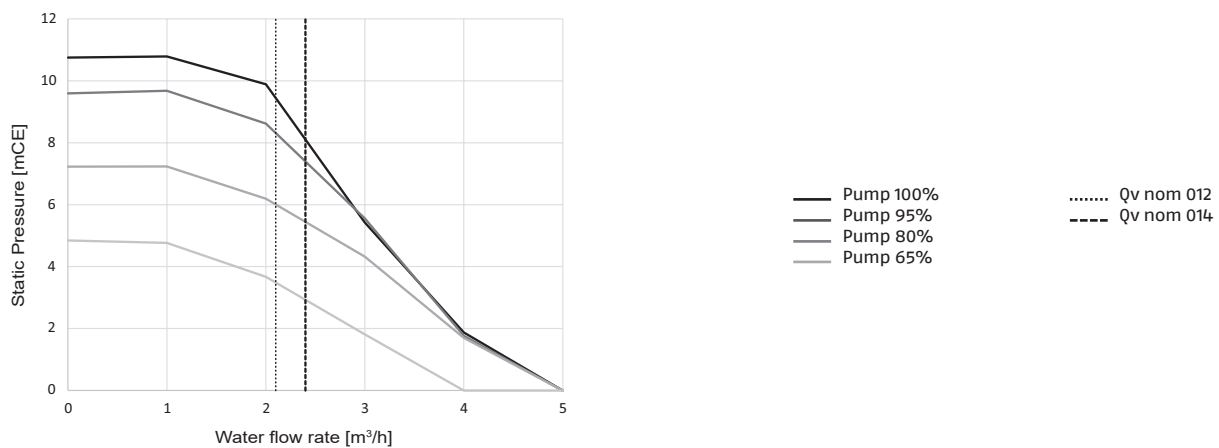

QUALITY REQUIREMENTS OF SYSTEM FILLING WATER

At initial start-up, the specialised technician must test the reference values of the system water using special test kits. The quality of the water used must meet the requirements stated in the table below; otherwise, a treatment system must be installed.

System water reference values		
pH		6,5 ÷ 7,8
Electrical conductivity	S/cm	250 ÷ 800
Total hardness	°F	5 ÷ 15
Total iron	ppm	0,2
Manganese	ppm	< 0,05
Chlorides	ppm	< 250
Sulphur ions		none
Ammonia ions		none

Well or groundwater not coming from the aqueduct should always be carefully analysed and if necessary conditioned with appropriate treatment systems.

If the initial water hardness exceeds the value indicated in the table, a water softening system must be used.

Excessive water softening (total hardness < 1.5 mmol/l) could lead to corrosion on contact with metal elements.

The conductivity value must also be kept within 600 S/cm.

Check the chloride concentration at the outlet after regeneration of the resins.

It is strictly prohibited to introduce acids into the washing circuit.

It is strictly prohibited to constantly or frequently top up the system, as this can damage the heat exchanger of the appliance.

WATER CONTENT AND WATER FLOW RATE SYSTEM

Heat pumps require systems that guarantee a constant fluid flow rate to the device, within minimum and maximum values and with sufficient volumes to avoid any imbalance in the cooling circuits and ensure the correct degree of comfort.

WATER CONTENT

A minimum volume of water in the system's primary circuit must be guaranteed for the appliance to operate correctly.

The minimum volume is necessary to prevent the risk of ice formation during defrosting operations or continuous modulation of the compressor frequency.

It also provides the following advantages:

- less appliance wear;
- increase in system efficiency;
- improved stability and temperature precision.

The water flow rate shall be maintained constant during operation and shall comply with

Model	UM	30AWHP							
		004	006	008	010	012	014	012T	014T
Minimum system water content	l	48	72	96	120	144	168	144	168
Minimum water flow rate	m ³ /h	0,44	0,65	0,85	1,08	1,28	1,55	1,28	1,55

ELECTRICAL CONNECTIONS

Please refer to the certified wiring drawings, supplied with the unit appliance shall be installed in accordance with national wiring regulations.

POWER SUPPLY

The power supply must conform to the specification on heat pump nameplate. The supply voltage must be within the range specified in the electrical data table. For connections refer to the wiring diagrams and the certified dimensional drawings.

CAUTION:

As a standard protection, it is mandatory to install a disconnect switch to be able to disconnect the power supply of the unit. Make sure to respect the wiring order to avoid electrical shock.



The use of an ATEX disconnect switch is mandatory if it is installed at less than one meter of the unit.

During the installation of the unit, only the side panel must be removed. The top panel shall not be removed at any time.



After the unit has been commissioned, the power supply must only be disconnected for quick maintenance operations (one day maximum). For longer maintenance operations or when the unit is taken out of service and stored (e.g. during the winter or if the unit does not need to generate cooling), water circuit and water heat exchanger must be drained.

This unit is equipped with electrically powered safety measures. To be effective, the unit must be electrically powered at all times after installation, other than when servicing.

Power supply connection diagram

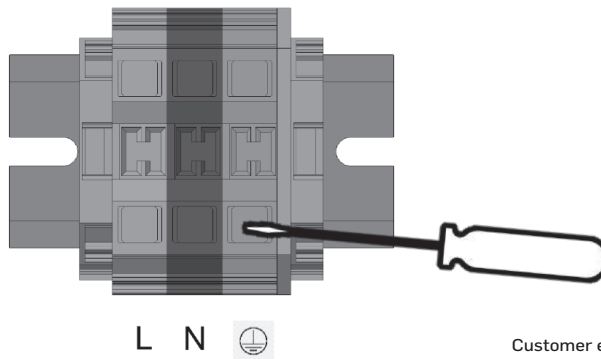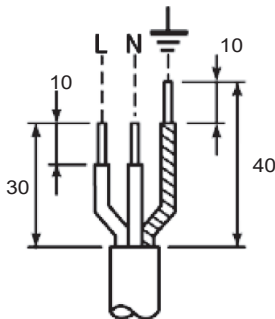

Customer electrical connection - Single phase

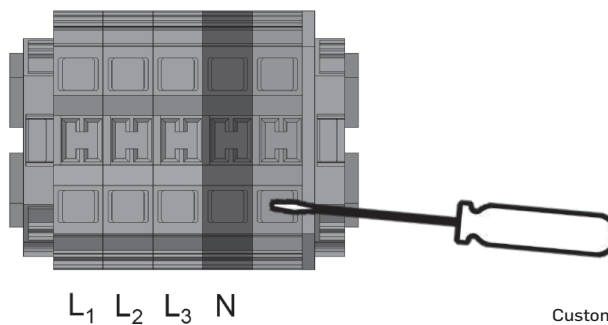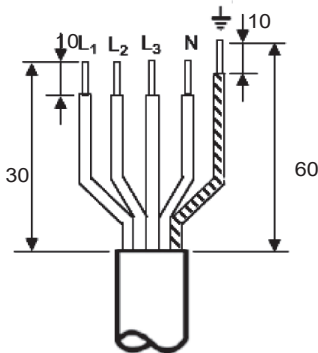

Customer electrical connection - Three-phase

Note: Recommended screwdrivers for wiring
 - 5 x 1 mm flat screwdriver (power terminal block)
 - 2 x 0.5 mm flat screwdriver (control terminal block)

RECOMMENDED WIRE SECTIONS

Wire sizing is the responsibility of the installer, and depends on the characteristics and regulations applicable to each installation site. The following is only to be used as a guideline, and does not make Manufacturer in any way liable. After wire sizing has been completed, using the certified dimensional drawing, the installer must ensure easy connection and define any modifications necessary on site.

The connections provided as standard for the field-supplied power entry cables are designed for the number and type of wires, listed in the table below.

The calculations of favourable and unfavourable cases are performed by using the maximum current possible of each unit (see the tables of electrical data for the unit).

The calculation is based on PVC or XLPE insulated cables with copper core. A maximum ambient temperature of 46°C has been taken into consideration. The given wire length limits the voltage drop to < 5% (length L in metres - see table below).

IMPORTANT:

Before connection of the main power cables (L1 - L2 - L3 - N - PE or L1 - N - PE) on the terminal block, it is imperative to check the correct order of the 3 phases before proceeding to the connection and the good connection of the neutral wire (if the neutral conductor is not connected correctly, the unit can be damaged permanently).

MINIMUM AND MAXIMUM WIRE SECTION (PER PHASE) FOR CONNECTION TO 30AWH-P UNITS

30AWH-P	Max. connectable section(1)	Calculation favourable case:			Calculation unfavourable case:		
		- Suspended aerial lines (standardised routing No. 17) - XLPE insulated cable			- Conductors in conduits or multi-conductor cables in closed conduit (standardised routing No. 41) - PVC insulated cable, if possible		
	Section	Section(2)	Max. length for voltage drop <5%	Cable type	Section(2)	Max. length for voltage drop <5%	Cable type(3)
mm (per phase)	mm (per phase)	m	-	mm (per phase)	m	-	
004	3G10	3G2.5	50	H07RNF	3G2.5	50	H07RNF
006	3G10	3G2.5	40	H07RNF	3G4	60	H07RNF
008	3G10	3G4	50	H07RNF	3G4	50	H07RNF
010	3G10	3G4	40	H07RNF	3G6	60	H07RNF
012	3G10	3G4	40	H07RNF	3G6	55	H07RNF
014	3G10	3G4	40	H07RNF	3G6	55	H07RNF
012T	5G4	5G1.5	50	H07RNF	5G4	150	H07RNF
014T	5G4	5G1.5	50	H07RNF	5G4	150	H07RNF
Accessory Remote WUI	Use cables H07RN-F 4x0,75 mm up to 50m to connect the user interface WUI (not supplied with accessory) CAUTION: Use the grey ferrite which is supplied in accessory to clamp around the WUI cable. Please clamp it directly after the customer's terminal block						


Notes:

- Connection capacities actually available for each machine, defined according to the connection terminal size, the control box access opening size and the available space inside the control box.
- Selection simulation result considering the hypothesis indicated.
- If the maximum calculated section is for an XLPE cable type, this means that a selection based on a PVC cable type can exceed the connection capacity actually available. Special attention must be given to the selection.

RECOMMENDED CUSTOMER ELECTRICAL PROTECTION


30AWH-P		004	006	008	010	012	014	012T	014T
Circuit breaker									
Type		C	C	C	C	C	C	C	C
Current	A	16	20	25	32	32	32	20	20
Fuses									
Type		gG	gG	gG	gG	gG	gG	gG	gG
Current	A	20	25	32	40	40	40	25	25

General customer electrical connection on terminal block

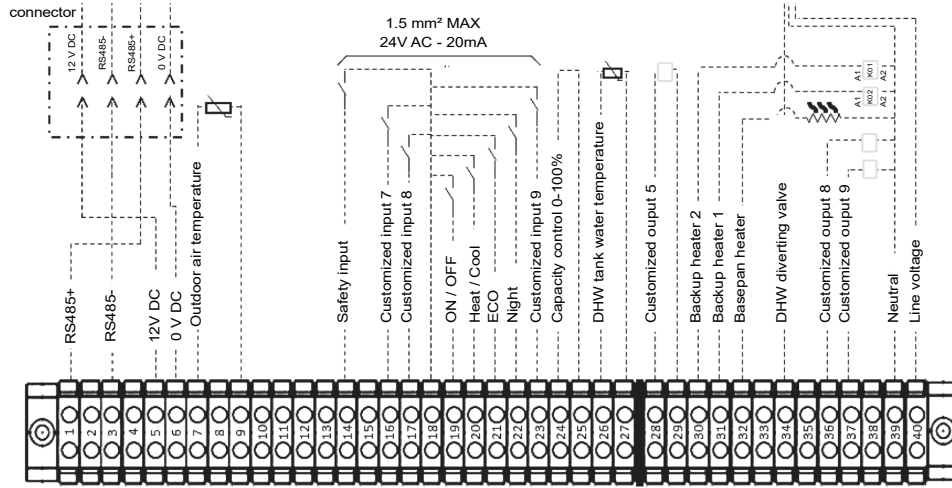

CONTROL PANEL

Your system is controlled by a Wall-Mounted User interface (WUI) that can be installed inside your home. This manual provides guidelines on how to use this interface effectively. If you have any questions regarding the display and its configuration, please contact your installer for more information.

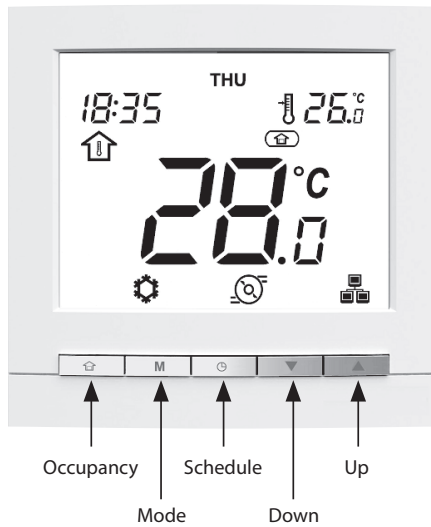



Key features

- Heating / Cooling: Depending on the unit, the system may operate in Heating or Cooling.
- Occupancy control allows you to easily set the system to operate in the following modes:

-  Home
-  Sleep
-  Away

- Easy temperature control: Depending on system configuration, room temperature or water temperature will be constantly displayed on the screen.

-  Room temperature icon indicates that system control is based on room temperature.
-  Water temperature icon means that the system is controlled according to water temperature.

- The setpoint which is the temperature to be achieved is displayed in the upper-right corner of the screen.
- Schedule control allows you to set the unit to operate with a set of pre-defined parameters (heating/cooling, occupancy, setpoint) in a specific period of time. You can always modify the schedule if

- necessary.
- Additional data display: In addition to the standard display, you may easily check other parameters, which provide information on the general status of the unit.
- Alarms are used to warn of potentially dangerous situations that may result in the failure of the unit.

TIP To configure the advanced parameters of the unit, please contact professional technicians.


MAIN ACCESSORIES

50 L INERTIAL TANK


Insulated 50-litre inertia tank designed to minimise heat pump on/off cycles when the system is running at almost full capacity. The inertia tank ensures, if required, the minimum water content in the system that the heat pump needs, depending on the installed capacity. This ensures the machine runs efficiently and optimally even in part load conditions.

- For hot and cold applications;
- It can be installed vertically or horizontally, inside or outside the building;
- It can be installed horizontally under the heat pump, thus minimising any space availability issues;
- Filling and emptying caps;
- Fitted with rubber elements to dampen the vibration generated by the heat pump.

WALL INSTALLATION

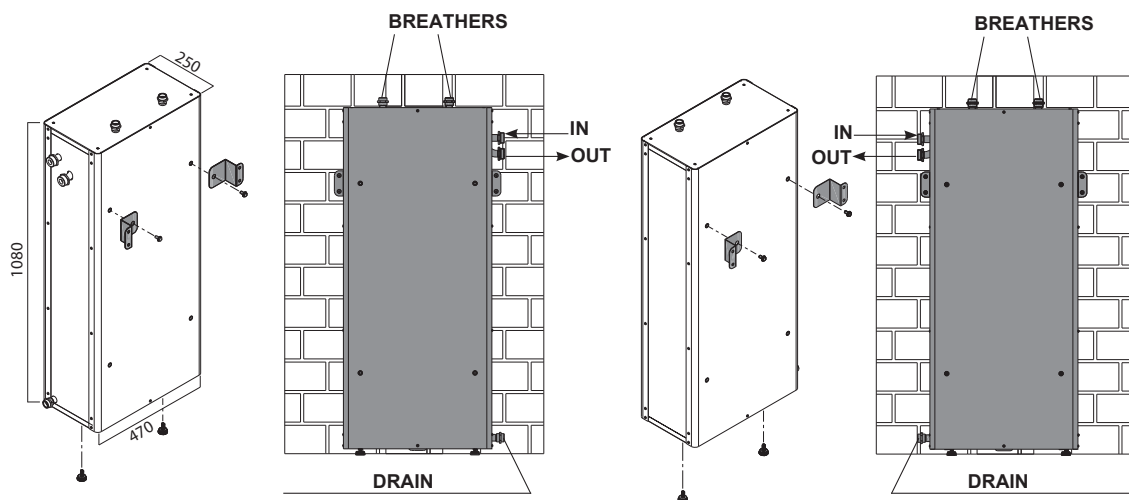


FLOOR INSTALLATION

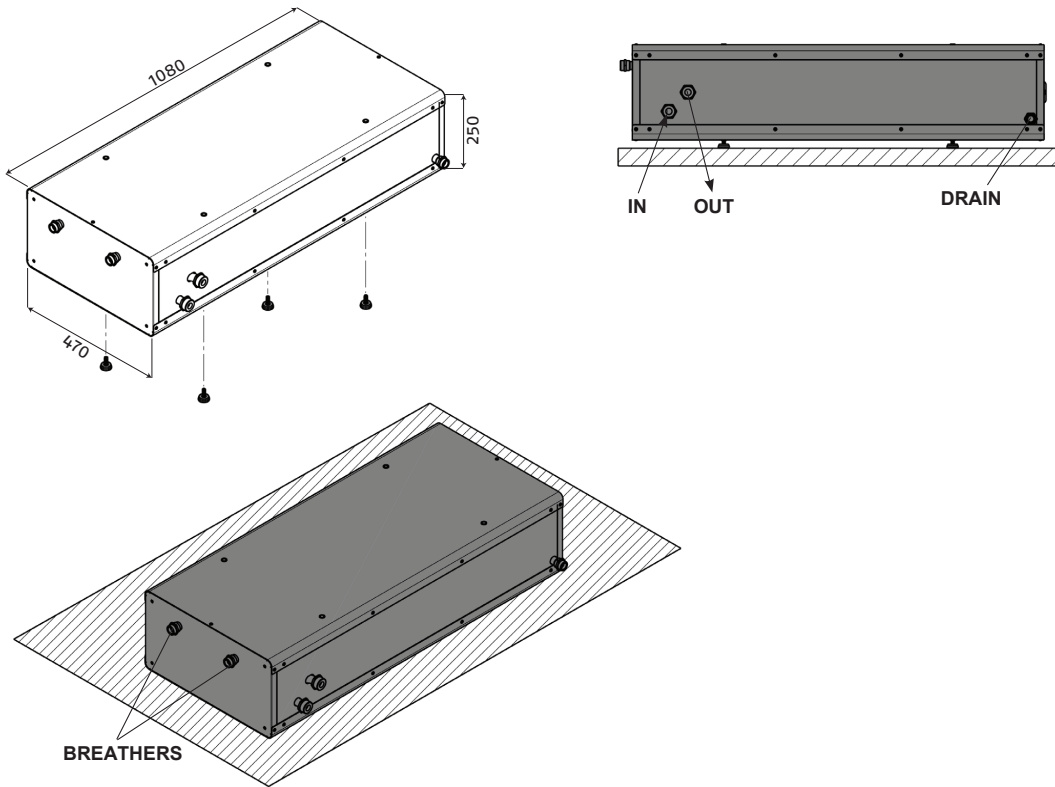

Specific tank conductivity 0.94 (W/K)

HEAD LOSS

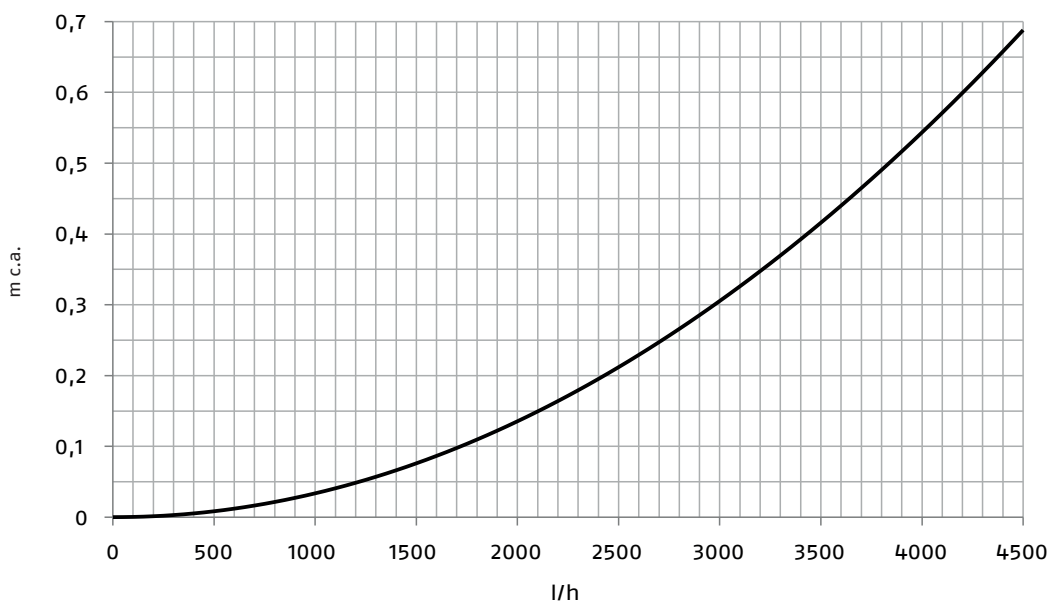


DIVERTER VALVE


3-way motorised full bore ball diverter valve for automatic diversion of the heat-transfer fluid distributed in air conditioning or DHW distribution systems.

Common fluid way: AB fluid passes on way A or on way B. G1" or G1 1/2" fittings available (ISO 228-1). CW617N brass body. CW617N brass ball, chrome-plated. Ball hydraulic seal in PTFE (Teflon®) with O-Ring in EPDM Perox TIMO. O-Ring in EPDM Perox TIMO. Motor casing in PA66 GF25 – UL94-V0. Usage fluids water and glycol solutions; maximum glycol percentage 50%. Nominal pressure 16 bar.

PN16. Maximum operating differential pressure 6 bar. Outflow coefficient, Kvs: 15.5. Fluid operating temperature range 2 - 90 °C. Operating ambient temperature range 0 - 60 °C. Power supply 230 V (or 24 V); power input 7 W. Auxiliary micro contacts capacity 3 (1) A, 250 V. Protection rating IP 40. Insulation class: II - Ref. European standard EN 60730. Commutation time: 25 s.

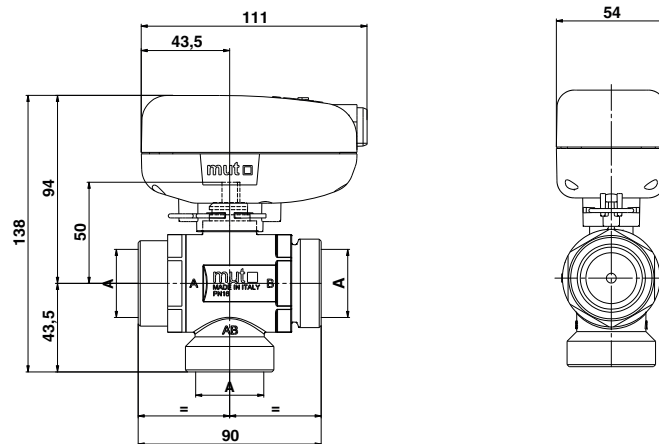


DIVERTER VALVE ASSEMBLY

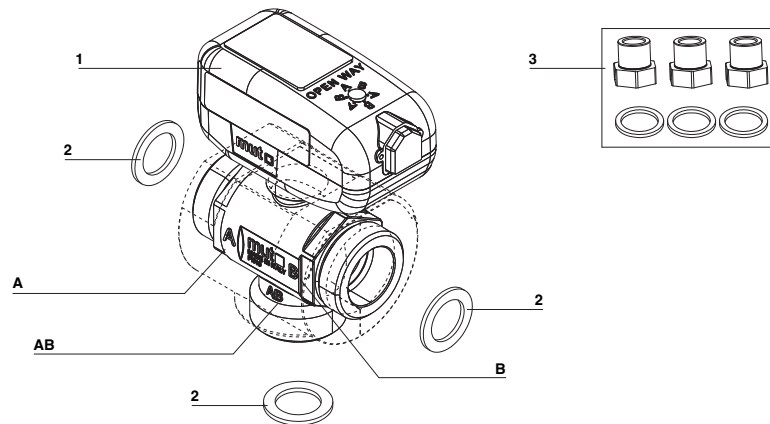

1. 3-way motorised ball diverter valve **SPST** 230 Vac-50/60 Hz - 1"1/4 M fitting
2. 1" flat gasket in Centellen
3. Unions for adapters 1" 1/4 F- 1" 1"1/4 F - 1" M and relative gaskets

ELECTRICAL CONNECTIONS

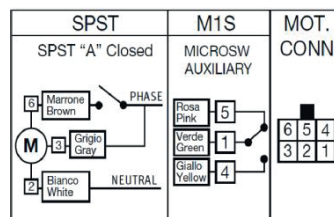

To connect the electricity, see the terminal board of the indoor unit

FUNCTIONAL CHARACTERISTICS


- AB way always open
- Type of valve operation: diverter (on/off)
- Nominal pressure: PN16
- Max. differential pressure: 6bar
- Flow rate coefficient Kvs in diversion: 90° ([m3/h] at ΔP= 1bar): Kvs=15.5
- Fittings: Threaded - ISO 228/1
- Full bore valve (DN25)
- Fluid temperature limits: 2 ÷ 90 °C [max]
- Usage fluid: Water, glycol solutions [max 50%]
- Ambient temperature range: 0 - 60 °C
- Type of actuation: SPST = Single-pole external electr. comm. (with built-in relay)
- With 1 auxiliary micro as standard: 3(1)A - 250 Vac
- Insulation class: II Ref. European standard EN 60730
- Protection rating: IP 40 Ref. European standard IEC EN 60529
- Type of connector: Molex Mini-Fit JR 6 pole or compatible
- Cable length: 1000 mm
- Voltage: 230V or 24V
- Synchronous motor
- Electric power supply: 230V (10%) - 50/60 Hz / 24V (10%) - 50/60 Hz
- Power input: 7W(Max)
- Manoeuvre ON time: 25 s
- Manoeuvre OFF time: 25s

MATERIALS

- Valve body: Brass
- Control shaft: Brass
- Ball: Brass
- Seal rings: PFTE (Teflon®)
- O-Rings: EPDM Perox (TIMO®)
- Servomotor casing: PA66GF30 (ISO 1874-PA 66, GHR, 14-100, GF30)


LOAD LOSS GRAPH

Load losses do not vary substantially with the variation of the route travelled, nor with the variation of the direction of travel.

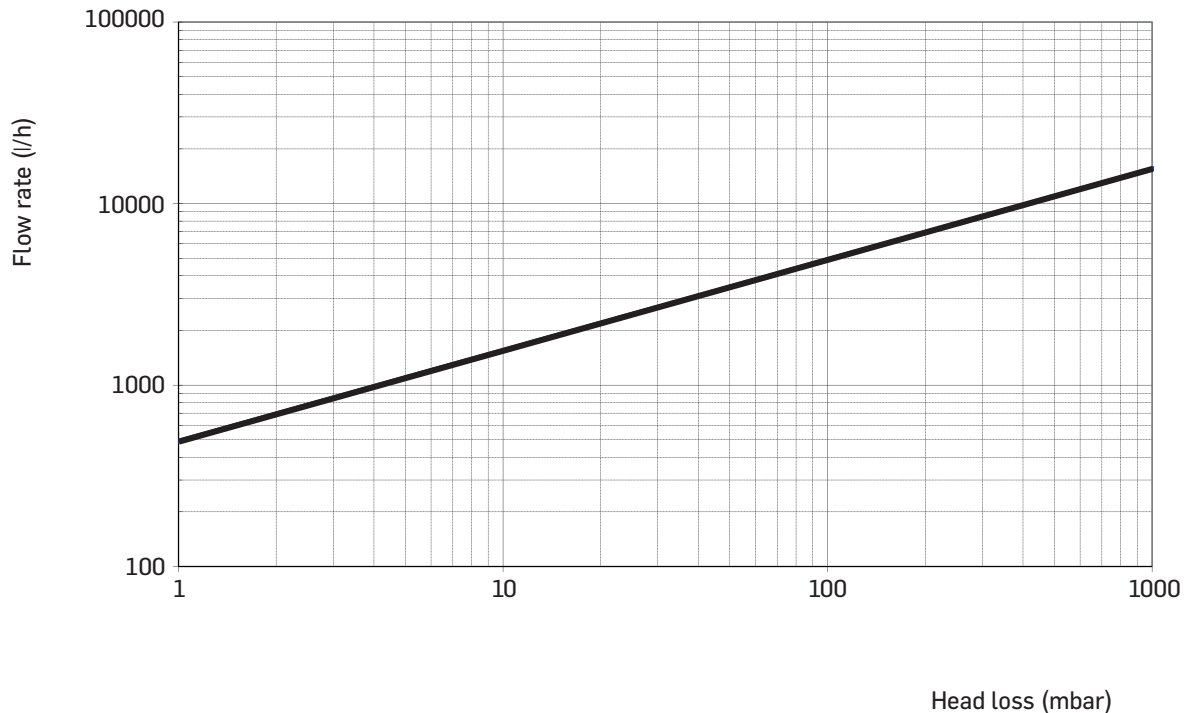


WATER FILTER Y 1"


DIMENSIONS

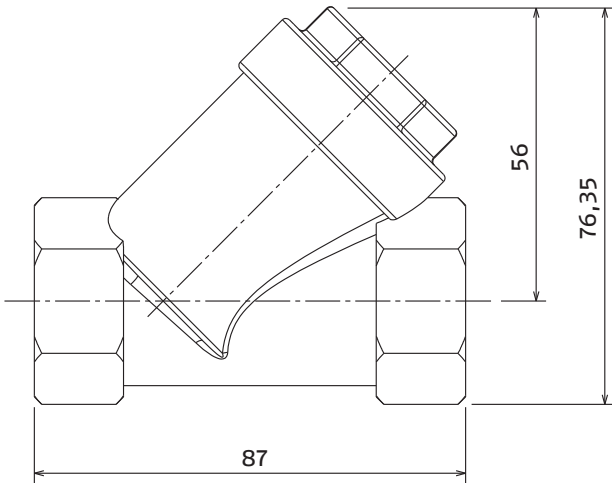

Y WATER FILTER ASSEMBLY

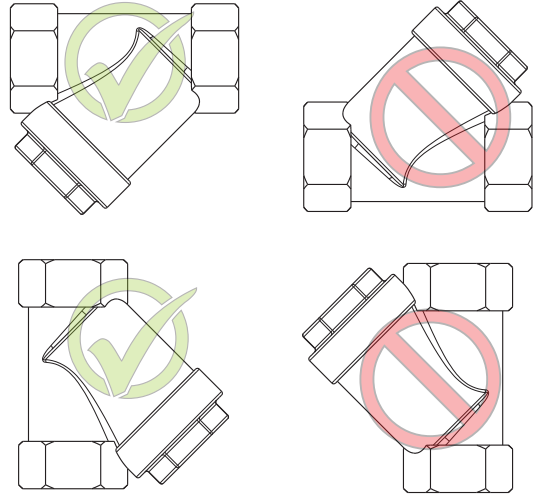

HEAD LOSS

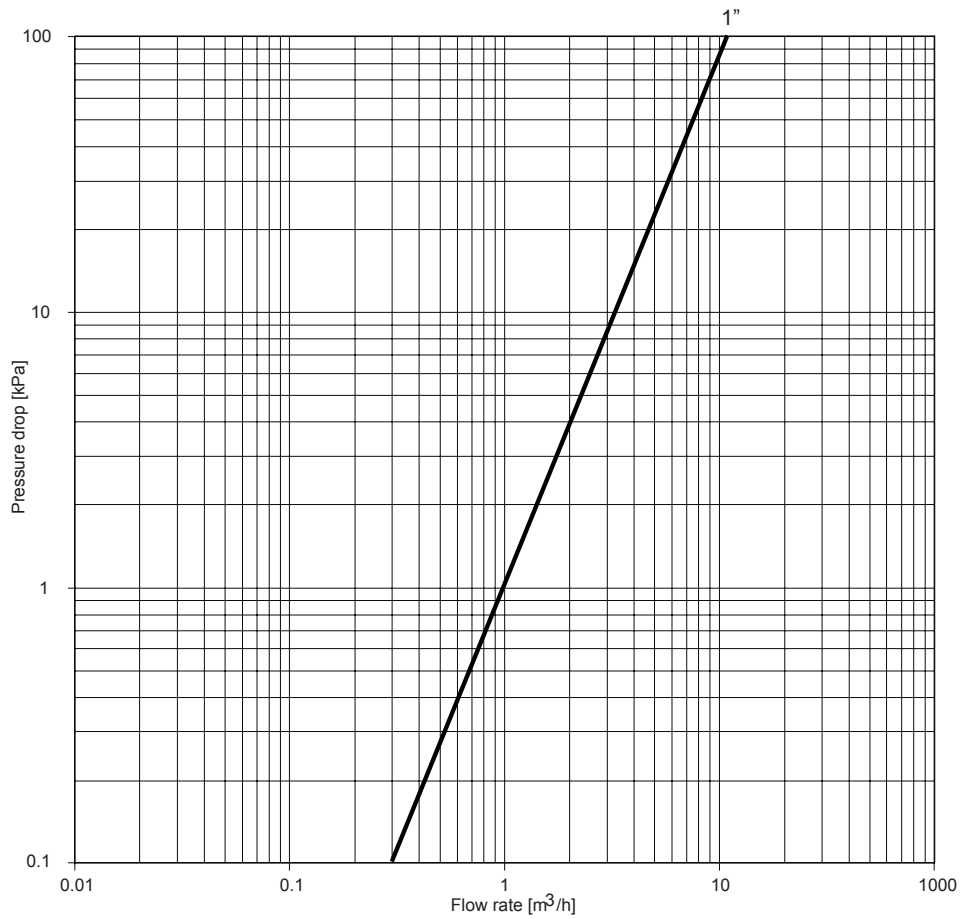

MEASUREMENT	Kv
1"	11

SPECIFICATION DESCRIPTIONS

The low GWP natural gas R290 hydronic heat pumps 30AWH-P are high-efficiency, ErP-compliant monobloc heat pumps (Class A+++ , SCOP up to 4.82).

Main features:

- inverter fans for silent operation
- compressor Twin Rotary with DC inverter technology and control via a PWM signal, wide modulation range with R290 gas
- gas/water plate heat exchanger
- self-modulating high-efficiency electronic circulator and electronic part with integrated advanced functions
- remote control panel, connected to the outdoor unit via ModBus (4 wires), which can also perform the function of an ambient probe with weekly time programmer

COMPRESSOR

- Advanced technology ensuring optimum energy efficiency and characterised by high output levels in peak conditions and optimised efficiency at low and medium compressor speeds.
- The heat pump 30AWH-P is equipped with IPDU (intelligent power drive unit) hybrid technology with an inverter, which combines two electronic control logics: pulse amplitude modulation (PAM) and pulse width modulation (PWM), to ensure optimised compressor operation under all operating conditions, minimise temperature fluctuations, and provide perfect comfort regulation, all while significantly reducing energy consumption.
- PAM: the modulation of the direct current pulse amplitude commands the compressor to work in maximum load conditions (start-up and peak load) so as to increase the voltage in the case of a fixed frequency. The compressor works at high speed to quickly reach the required temperature
- PWM: the modulation of the direct current pulse width commands the compressor to work in partial load conditions, adapting the frequency in the case of a fixed voltage. The compressor speed is precisely regulated and the system offers a high comfort level (no temperature fluctuations) in working conditions of outstanding efficiency.
- The compressor frequency increases constantly until it reaches the maximum level.
- This ensures that there are no intensity peaks during the start-up phase, and also means a secure connection to the single-phase current supply even for high-output systems.
- The two rotating blades of the compressor are dephased by 180°. Along with the DC brushless motor, fitted with a perfectly balanced shaft, they guarantee that noise and vibrations are kept at a minimum even at extremely low operating speeds.
- All twin rotary compressors with brushless DC inverter motor are equipped with casing assembly resistors as standard.
- The compressor has a double protective sound insulation shield to further reduce the noise levels.

EXTERNAL COIL

- The new aluminium-copper coil features a blue hydrophilic coating, which allows water to move more easily (by gravity) towards the bottom of the heat exchanger.
In particular, this innovation means:
 - the frosting time to be increased by reducing the accumulation of frost on the coil
 - better defrosting by improving the flow of water over the fins.

EXTERNAL FAN

- Variable speed fans (driven by a VFD variable frequency drive system) with patented, innovative impellers shaped for optimal air distribution combined with exceptionally low sound levels.

ELECTRONIC EXPANSION VALVE

- The electronic expansion valve is a dual flow electronic expansion device whose job is to optimise the volume of the refrigerant fluid in the circuit and therefore the overheating issue, preventing the fluid from returning to the compressor. This device further boosts the high efficiency and reliability of the system as it enables to work even with very low condensation pressure values across the whole operating range.

PLATE HEAT EXCHANGER

- Vertical plate heat exchanger made of AISI 316 stainless steel insulated with closed-cell anti-condensation coating ranging from 6 to 13 mm.

TOP PERFORMANCE

- 30AWH-P extremely high level of energy efficiency in both heating and cooling mode, thereby guaranteeing significant energy savings. The large, high-efficiency coils, together with the optimised circuits, ensure results that meet the European ecodesign directive. Efficiency levels in partial load conditions (seasonal energy efficiency) are one of the highest in this industrial sector.

Comfort throughout the year: the ground-breaking technology employed for 30AWH-P means boosted comfort levels for users in terms of both water temperature control and quiet operation. The required temperature is reached quickly and kept constant, without any fluctuations. 30AWH-P optimised, personalised comfort levels both in winter and in summer.

- 30AWH-P can work in cooling mode even with low outdoor temperatures (from 10 °C, and up to 46 °C). To ensure the maximum comfort for the user, the units work in heating mode with outdoor temperatures down to -20°C, whereas in summer they can produce hot water up to 75°C for DHW applications, with the outdoor temperature as high as 40°C.
- 30AWH-P also with new FREE DEFROST technology. This advanced control logic allows energy to be extracted from the outside air, so that defrosting is energetically optimised without the need for any compressor intervention. In fact, defrosting via the FREE DEFROST system, unlike traditional defrosting, has practically no thermal impact on the water circuit.

RELIABILITY

- Each unit is subject to testing during all stages of production to ensure the tightness of the circuit, electrical compliance, and correct water and refrigerant fluid pressure. At the end of production, all operating parameters of the unit are thoroughly tested. Corrosion resistance test. Accelerated ageing tests on critical components and fully assembled units, with simulation of thousands of hours of continuous operation.

Standard equipment

The heat pumps 30AWH-P are delivered fixed on a wooden pallet and protected by polystyrene packaging.

The following documents can be found inside the packaging:

- instruction booklet for the installer and for Technical Services
- instruction booklet for the user
- spare parts/warranty labels
- energy labels

The heat pumps 30AWH-P are compliant with:

- 2006/42/EC Machinery Directive
- 2014/30/EU Electromagnetic Compatibility Directive
- 2014/68/EU Pressure Equipment Directive
- 2009/125/CE Ecodesign Directive
- Ecodesign regulation (EU) No 813/2013
- Energy Labelling regulation (EU) No 811/2013
- 2011/65/EU Restriction of Hazardous Substances Directive (RoHS)
- REACH regulation (EC) No 1907/2006

The quality management system of this product's assembly site has been certified in accordance with the requirements of the ISO 9001 standard (latest current version) after an assessment conducted by an authorized independent third party.

The environmental management system of this product's assembly site has been certified in accordance with the requirements of the ISO 14001 standard (latest current version) after an assessment conducted by an authorized independent third party.

The occupational health and safety management system of this product's assembly site has been certified in accordance with the requirements of the ISO 45001 standard (latest current version) after an assessment conducted by an authorized independent third party.

Please contact your sales representative for more information.

Order No.: 10743, 10.2023. Supersedes order No.: 10743, 08.2022.

Carrier SCS, Montluel, France.

Manufacturer reserves the right to change any product specifications without notice.

The illustrations in this document are for illustrative purposes only and not part of any offer for sale or contract. The manufacturer reserves the right to change the design at any time without notice.